

IOWA STATE UNIVERSITY

EE 455 Introduction to Energy Distribution Systems

Introduction to Power Distribution Systems

Dr. Zhaoyu Wang

Department of Electrical and Computer Engineering


Iowa State University

wzy@iastate.edu


Acknowledgement: The slides are developed based in part on Distribution System Modeling and Analysis, 4th edition, William H. Kersting, CRC Press, 2017 and Electric Power Distribution Handbook, 2nd edition, T. A. Short, CRC Press, 2014.

What is electric power distribution?

- Electric power distribution is the portion of the power delivery infrastructure that takes the electricity from the highly meshed, high-voltage transmission circuits and delivers it to customers.
- Some also think of distribution as anything that is radial or anything that is below 35 kV.

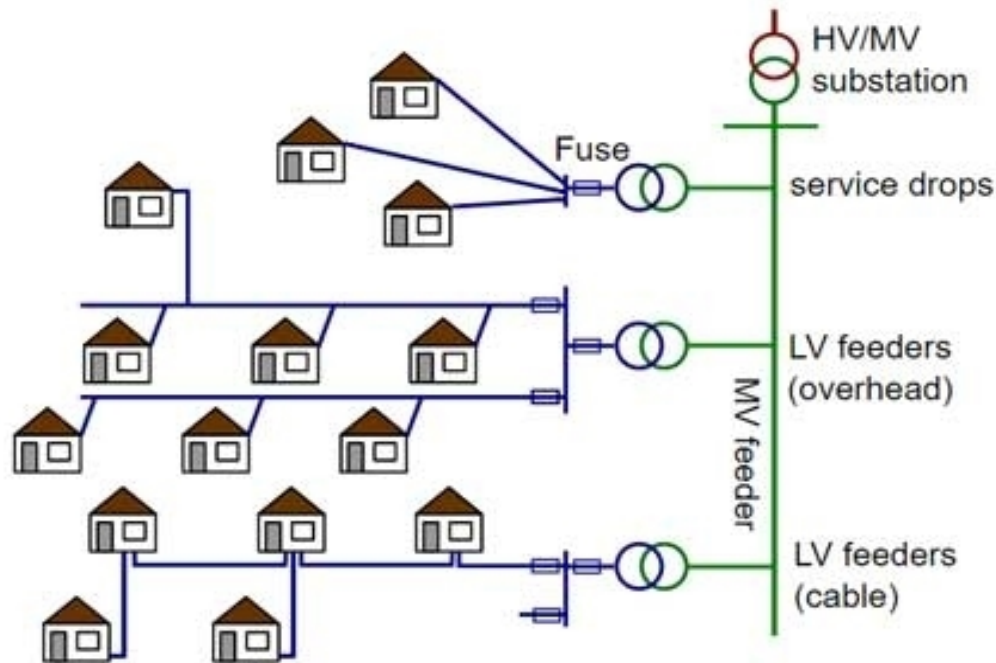


Overview of electricity infrastructure and role of electric power distribution

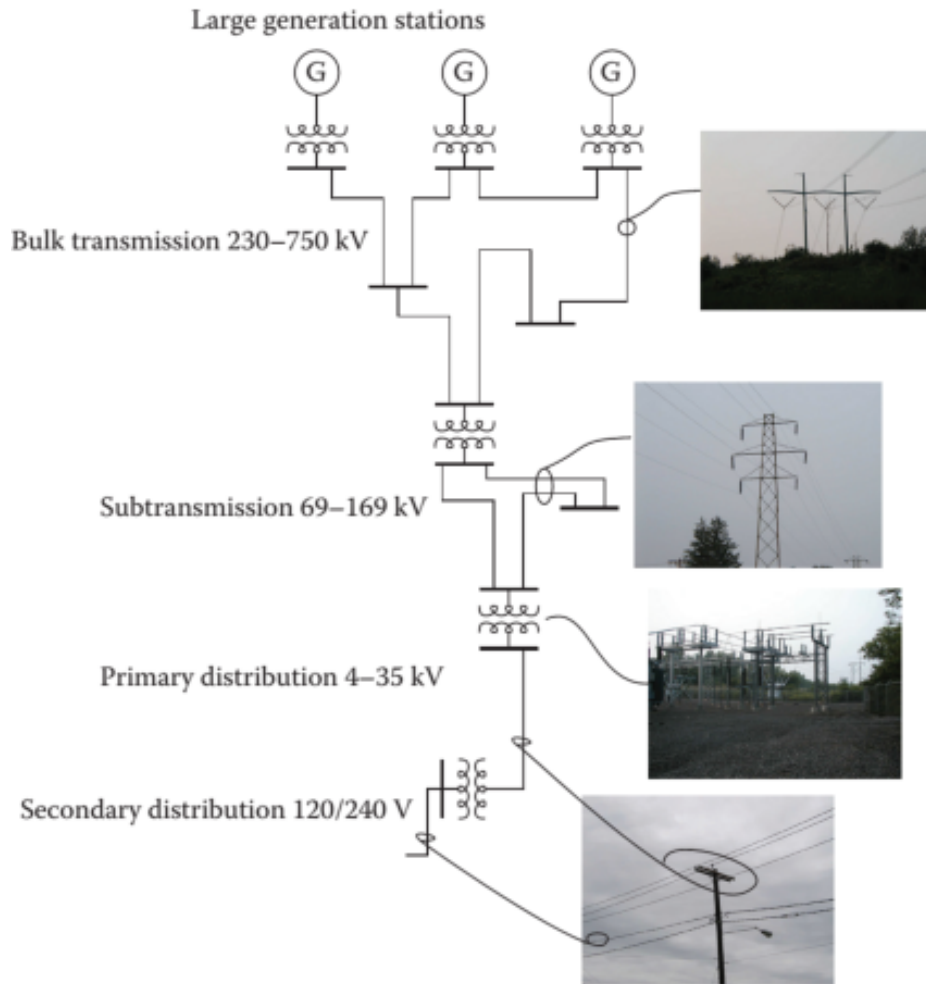

- At a distribution substation, a substation transformer takes the incoming transmission-level voltage (35 to 230 kV) and steps it down to several distribution primary circuits, which fan out from the substation.
- Primary distribution lines are “medium-voltage” circuits, normally thought of as 600 V to 35 kV.
- Close to end users, a distribution transformer takes the primary distribution voltage and steps it down to a low-voltage secondary circuit (commonly 120/240 V).
- From the distribution transformer, the secondary distribution circuits connect to the end user.

Overview of electricity infrastructure and role of electric power distribution

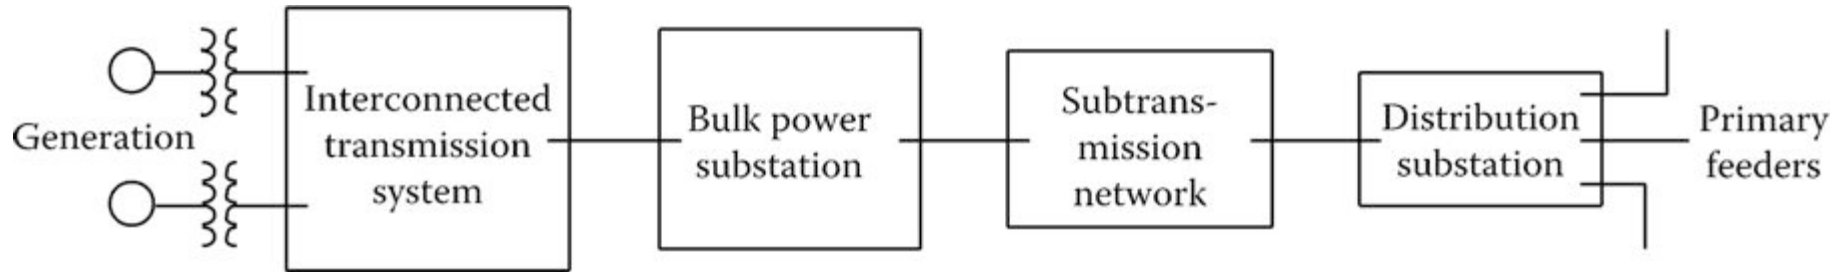

- Generation: 1kV-30 kV
- Ultra High Voltage Transmission: 500kV-765kV
- High Voltage Transmission: 230kV-345kV
- Sub-transmission system: 69kV-169kV
- Distribution system: 120V-35kV

What are the main differences between transmission and distribution systems?


- Meshed vs Radial
- Balanced vs Unbalanced
- Voltage levels
- R/X ratios

Distribution substation




<https://www.enengineering.com/expertise/power-transmission-distribution/>


Distribution substation

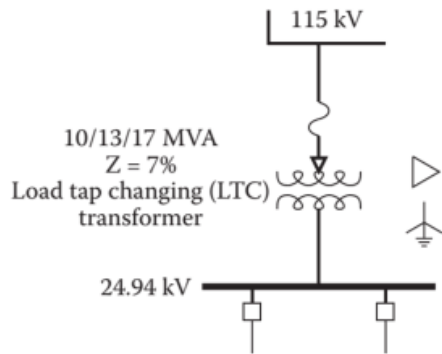

A rural distribution substation

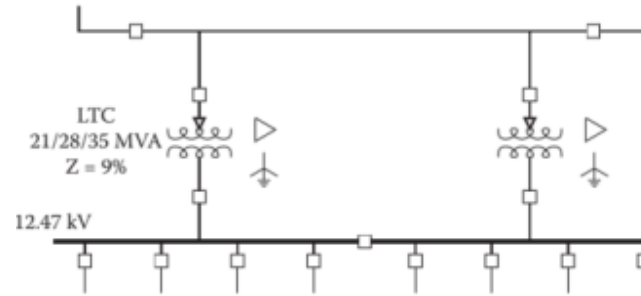


A suburban distribution substation

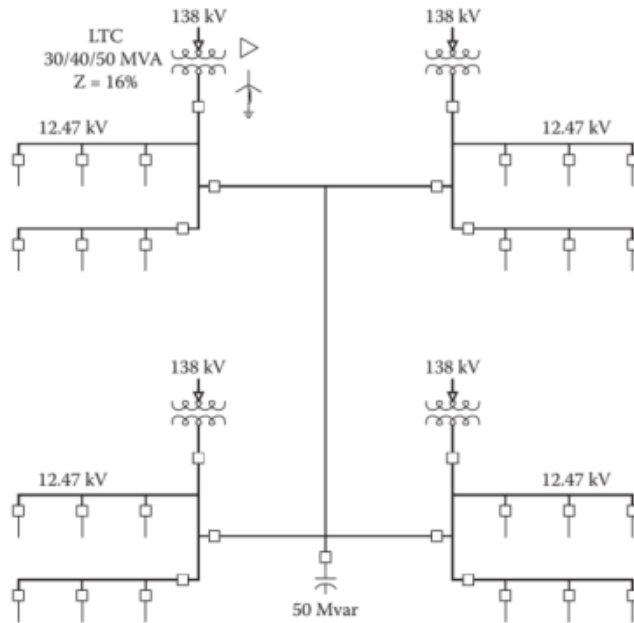

An urban distribution substation


- Distribution substations come in many sizes and configurations.
- A small rural sub-station may have a nominal rating of 5 MVA while an urban station may be over 200 MVA. The figures show examples of small, medium, and large substations.
- As much as possible, many utilities have standardized substation layouts, transformer sizes, relaying systems, and automation and SCADA (supervisory control and data acquisition) facilities.

Distribution substation

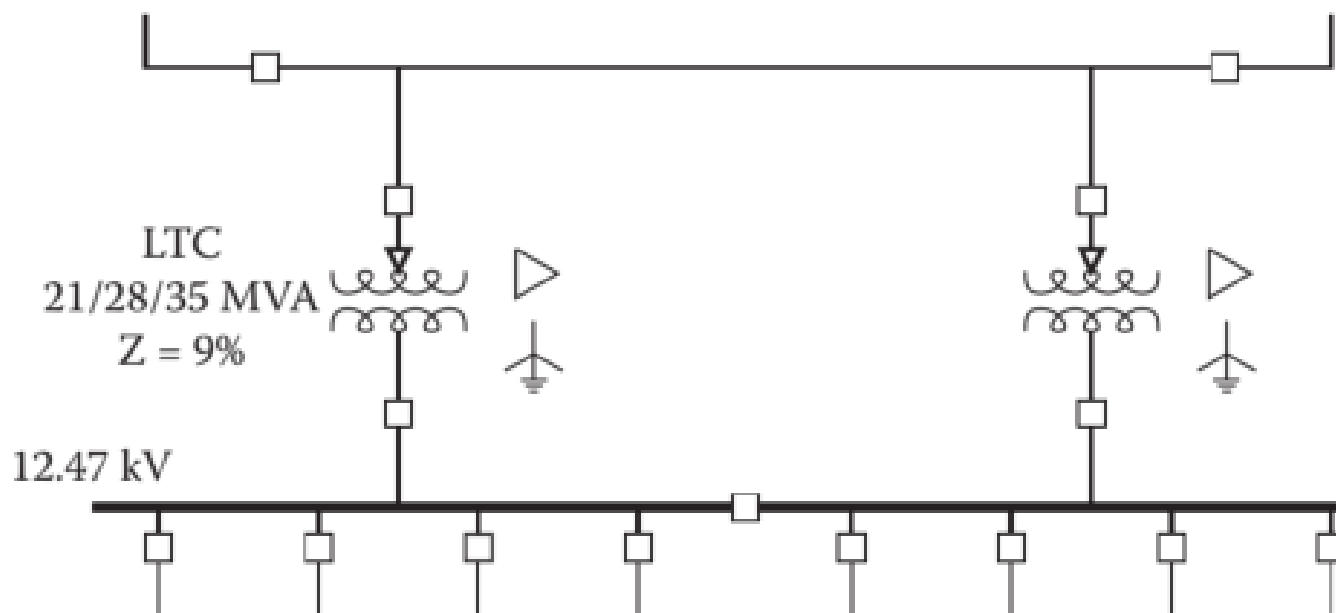


- Two-bank stations are very common; these are the standard design for many utilities.
- Normally, utilities size the transformers so that if either transformer fails, the remaining unit can carry the entire substation's load. Utility practices vary on how much safety margin is built into this calculation, and load growth can eat into the redundancy.

Distribution substation

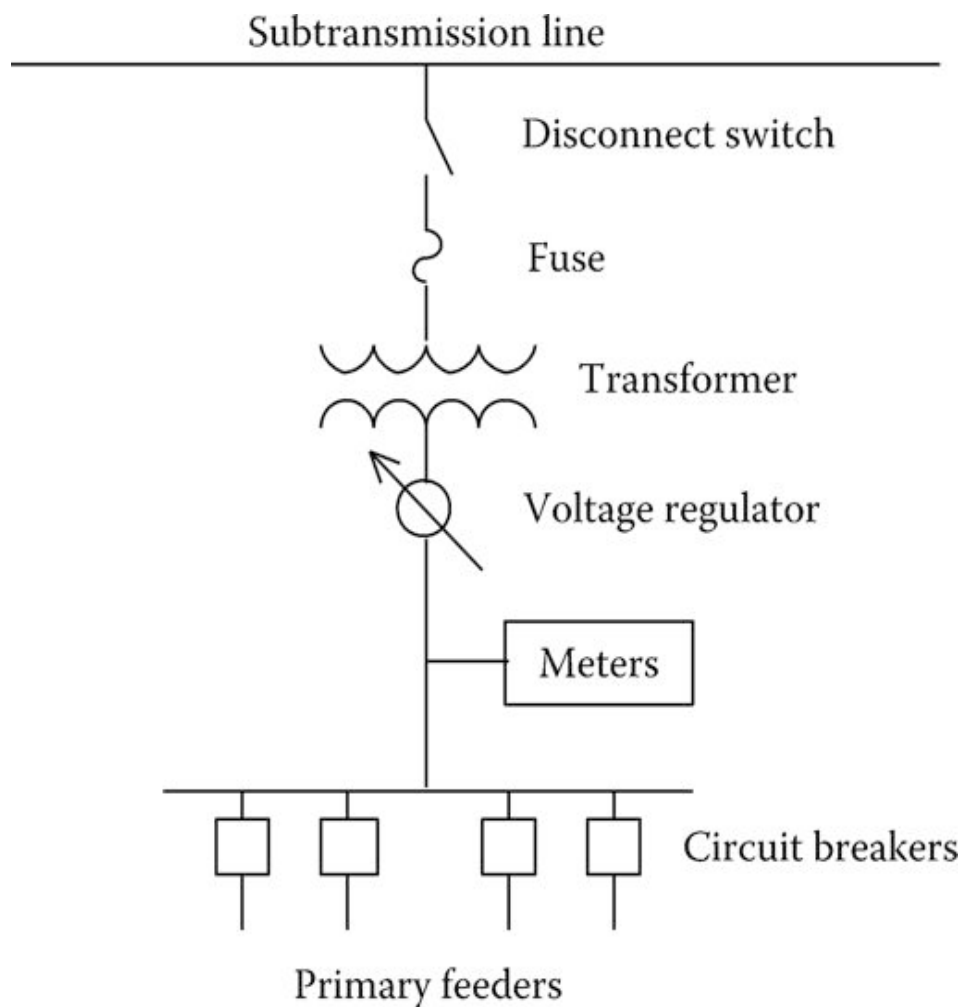


- High-side and low-side switching
- Voltage transformation: The primary function of a distribution substation is to reduce the voltage down to the distribution voltage level. In Figure, only one transformer is shown. Other substation designs will call for two or more three-phase transformers. There are many “standard” distribution voltage levels. Some of the common are 34.5, 23.9, 14.4, 13.2, 12.47, and, in older systems, 4.16 kV.

Distribution substation

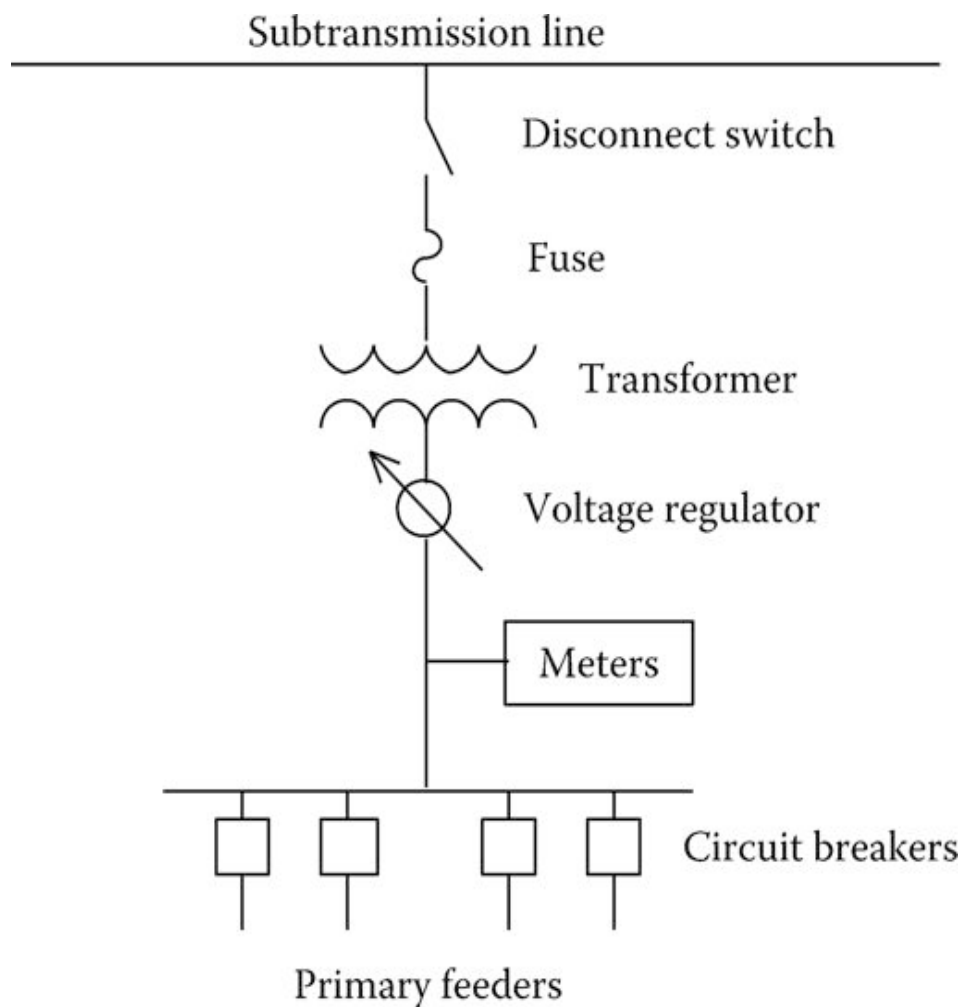


- Voltage regulation: As the load on the feeders vary, the voltage drop between the substation and the user will vary. In order to maintain the user's voltages within an acceptable range, the voltage at the substation needs to vary as the load varies. The voltage is regulated by a “step-type” regulator that will vary the voltage plus or minus 10% on the low-side bus. Sometimes this function is accomplished with a “load tap changing” (LTC) transformer. This can be in the form of a three-phase gang-operated regulator or individual phase regulators that operate independently.

Distribution substation

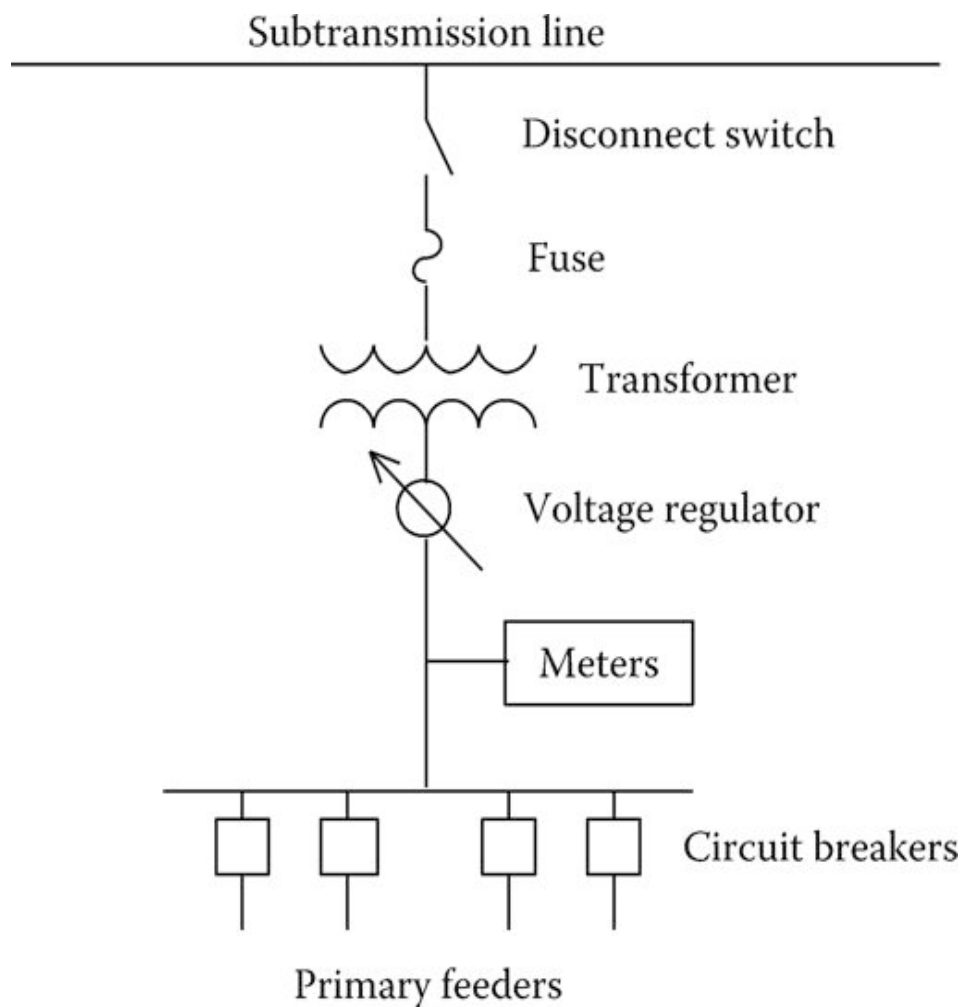


- Protection: The substation must be protected against the occurrence of short circuits. In the simple design of Figure, the only automatic protection against short circuits inside the substation is by way of the high-side fuses on the transformer. Individual feeder circuit breakers or reclosers are used to provide interruption of short circuits that occur outside the substation.

Distribution substation

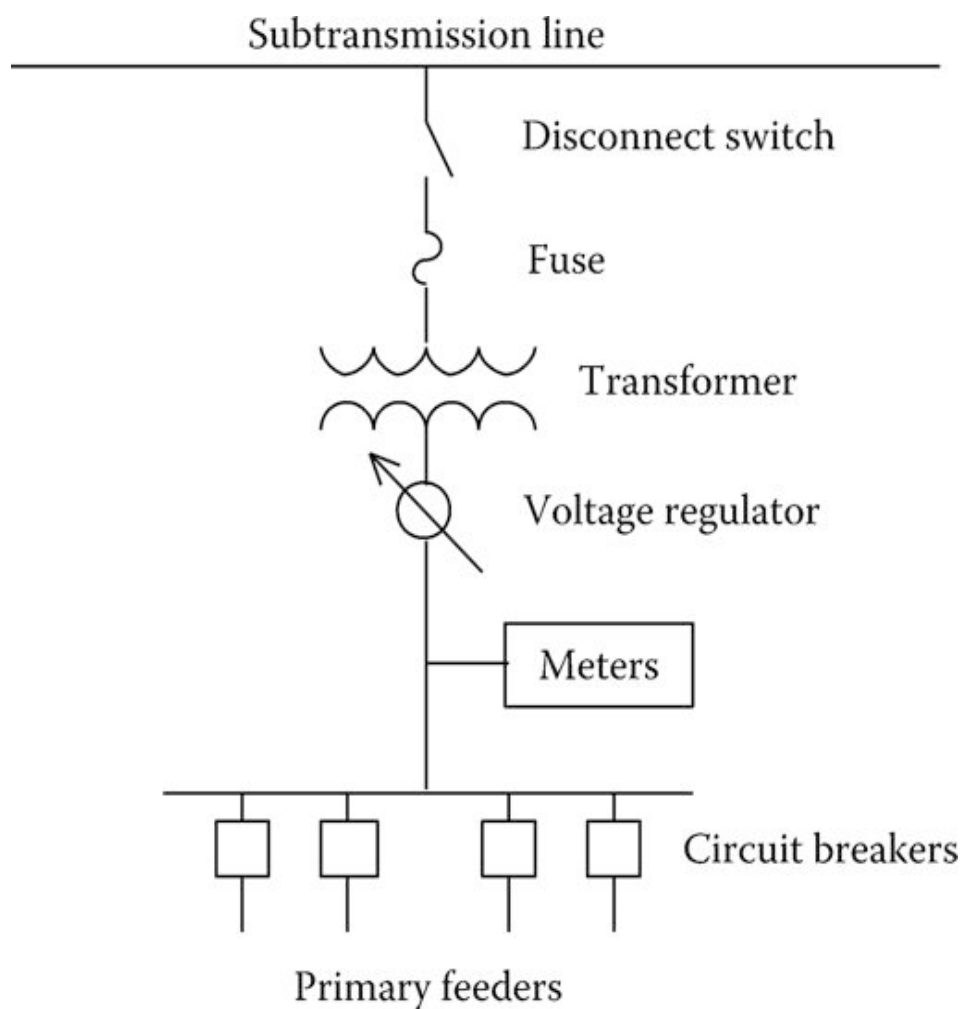

- Metering: Every substation has some form of metering. This may be as simple as an analog ammeter displaying the present value of substation current as well as the minimum and maximum currents that have occurred over a specific time period. Digital recording meters are becoming very common. These meters record the minimum, average, and maximum values of current, voltage, power, power factor, etc., over a specified time range. Typical time ranges are 15 min, 30 min, and 1 h.


Distribution substation

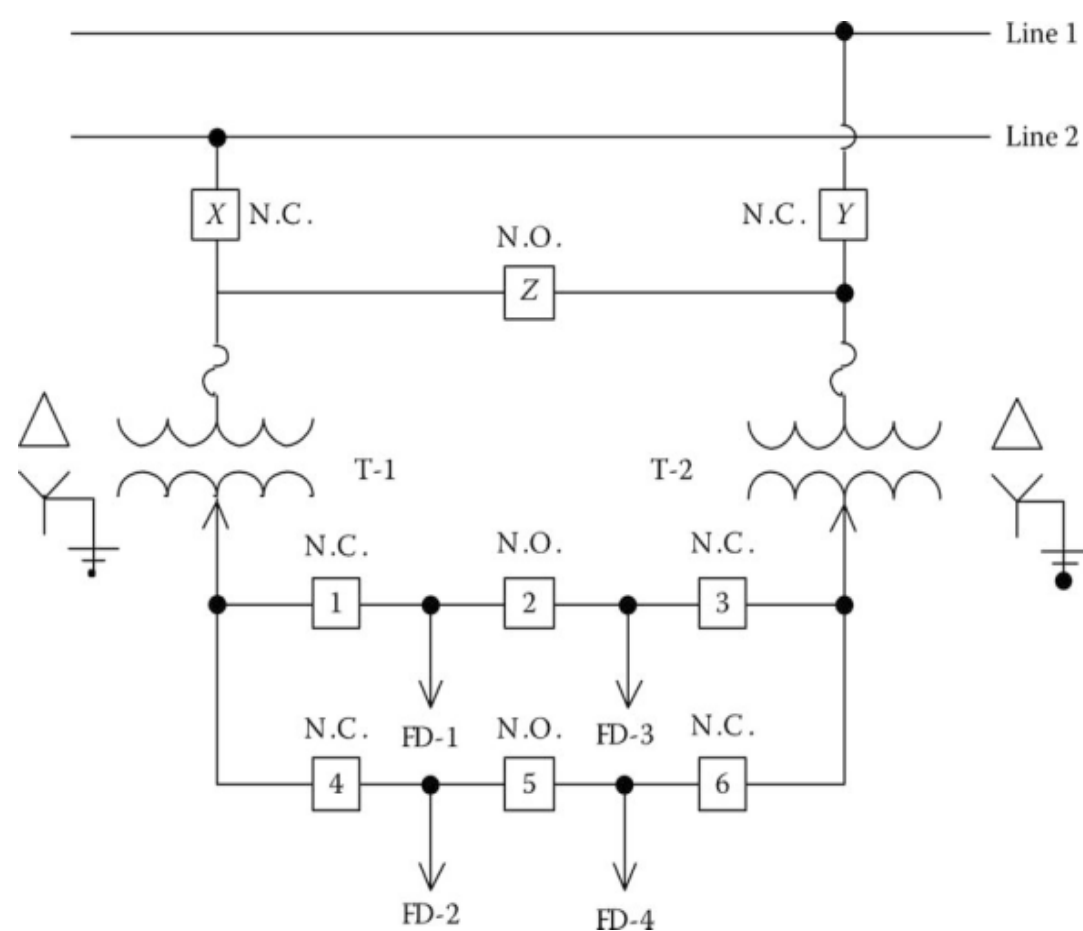

Under normal conditions, the circuit breakers (CB) are in the following positions:

- Circuit breakers closed: X, Y, 1, 3, 4, 6
- Circuit breakers open: Z, 2, 5
- Should one of the sub-transmission lines go out of service then breaker X or Y is opened and breaker Z is closed. Now both transformers are served from the same sub-transmission line. The transformers are sized such that each transformer can supply all four feeders under an emergency operating condition.

Distribution substation

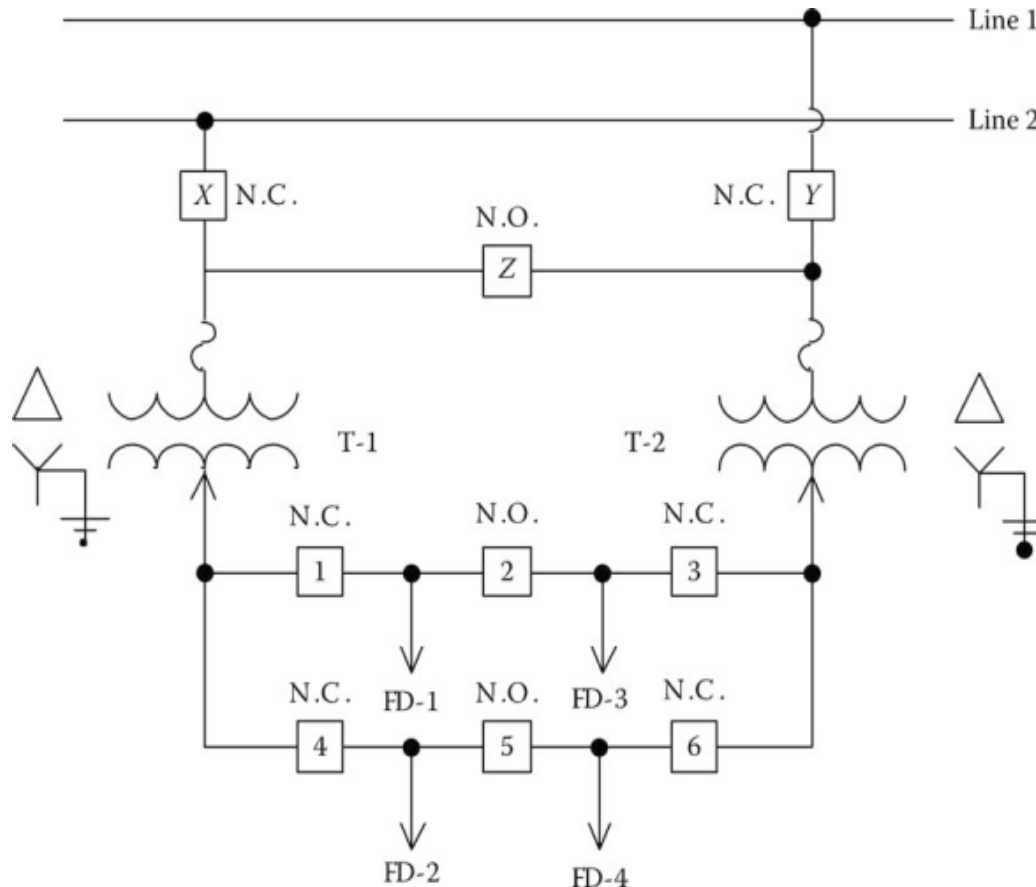


For example, if transformer T-1 is out of service, then breakers X, 1, and 4 are opened and breakers 2 and 5 are closed. With that breaker arrangement, all four feeders are served by transformer T-2. The low-voltage bus arrangement is referred to as a “breaker-and-a-half scheme” since three breakers are required to serve two feeders.

Distribution substation

- Consider a typical substation that might be fed by two incoming 138 kV lines feeding two 32 MVA, 138/12.47 kV transformers, each with a low-voltage bus. Each bus has four outgoing distribution feeders of 9 MVA peak capacity each. The total site cost of the substation is \$600,000. The total transmission cost including high-side bus circuit breakers is estimated to be \$900,000. The total costs of the two transformers and associated equipment is \$1,100,000. The feeder bus-work/getaway cost is \$400,000.
- The total cost of this substation= $\$600,000 + \$900,000 + \$1,100,000 + \$400,000 = \$3,000,000$

Primary distribution configurations

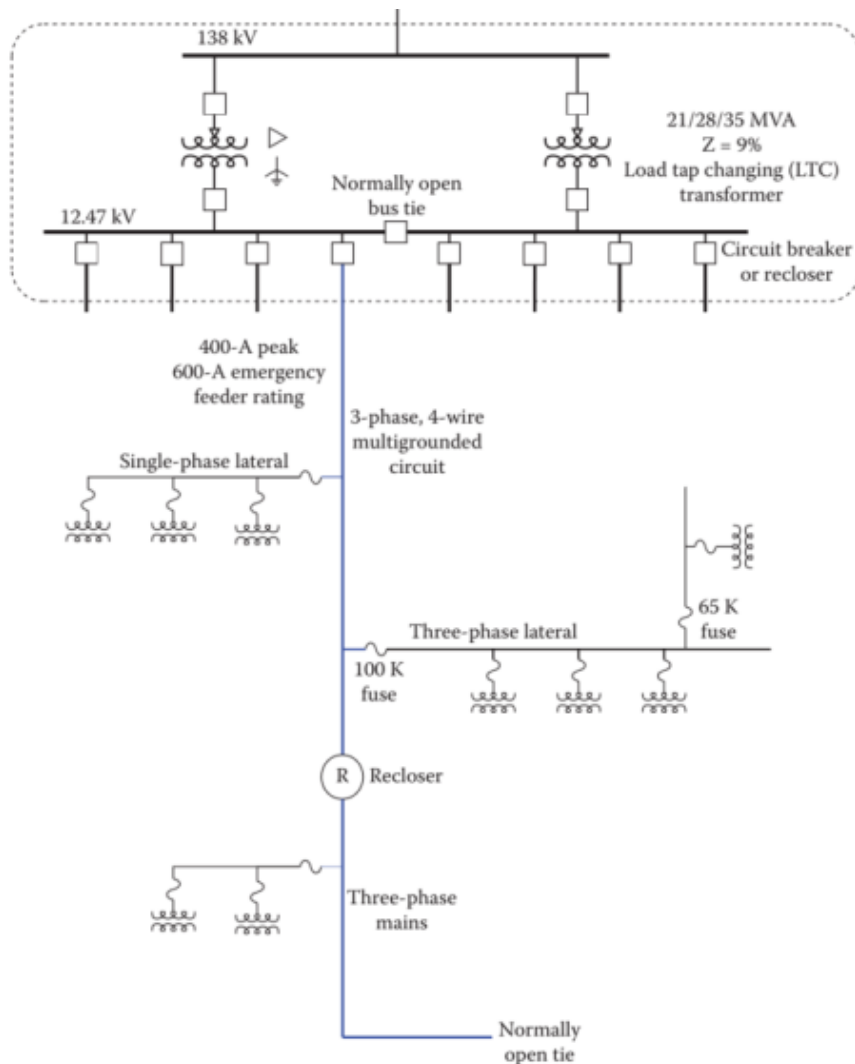


- Typical distribution substation with one of the several feeders shown (lateral taps are left off).
- A feeder is one of the circuits out of the substation.
- The main feeder is the three-phase backbone of the circuit, which is often called the mains or mainline. Main feeder is normally designed from 400 A and often allows an emergency rating of 600 A.
- Branching from the main feeders are one or more laterals, which are also called taps, lateral taps, branches, or branch lines. These laterals may be single phase, two phase, or three phase. The laterals normally have fuses to separate them from the mainline if they are faulted.

Primary distribution configurations


- The most common distribution primaries are four-wire, multi-grounded systems: three-phase conductors plus a multi-grounded neutral.
- Single-phase loads are served by transformers connected between one phase and the neutral. The neutral acts as a return conductor and as an equipment safety ground (it is grounded periodically and at all equipment).
- A single-phase line has one phase conductor and the neutral, and a two-phase line has two phases and the neutral. Some distribution primaries are three-wire systems (with no neutral). On these, single-phase loads are connected phase to phase, and single-phase lines have two of the three phases.
- Most distribution circuits are radial (both primary and secondary). Radial circuits have many advantages over networked circuits including
 - Easier fault current protection
 - Lower fault currents over most of the circuit
 - Easier voltage control
 - Easier prediction and control of power flows
 - Lower cost

Primary distribution configurations


Single mainline

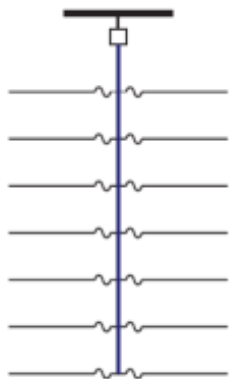


Express feeder

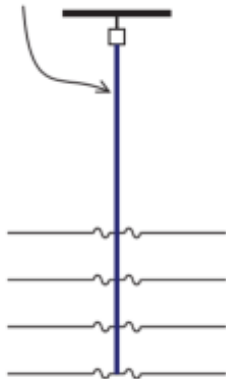

Branched mainline

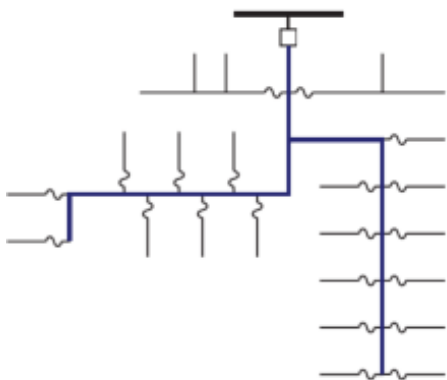


Very branched mainline

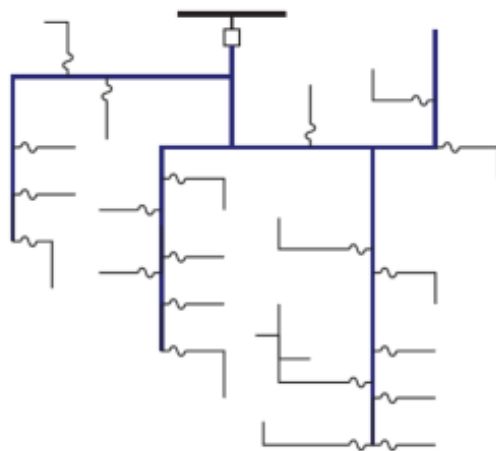


- The arrangements depend on street layouts, the shape of the area covered by the circuit, obstacles (such as lakes), and where the big loads are.
- A common suburban layout has the main feeder along a street with laterals tapped down side streets or into developments.
- Radial distribution feeders may also have extensive branching—whatever it takes to get to the loads.
- An express feeder serves load concentrations some distance from the substation. A three-phase mainline runs a distance before tapping loads off to customers. With many circuits coming from one substation, a number of the circuits may have express feeders; some feeders cover areas close to the substation, and express feeders serve areas farther from the substation.

Primary distribution configurations

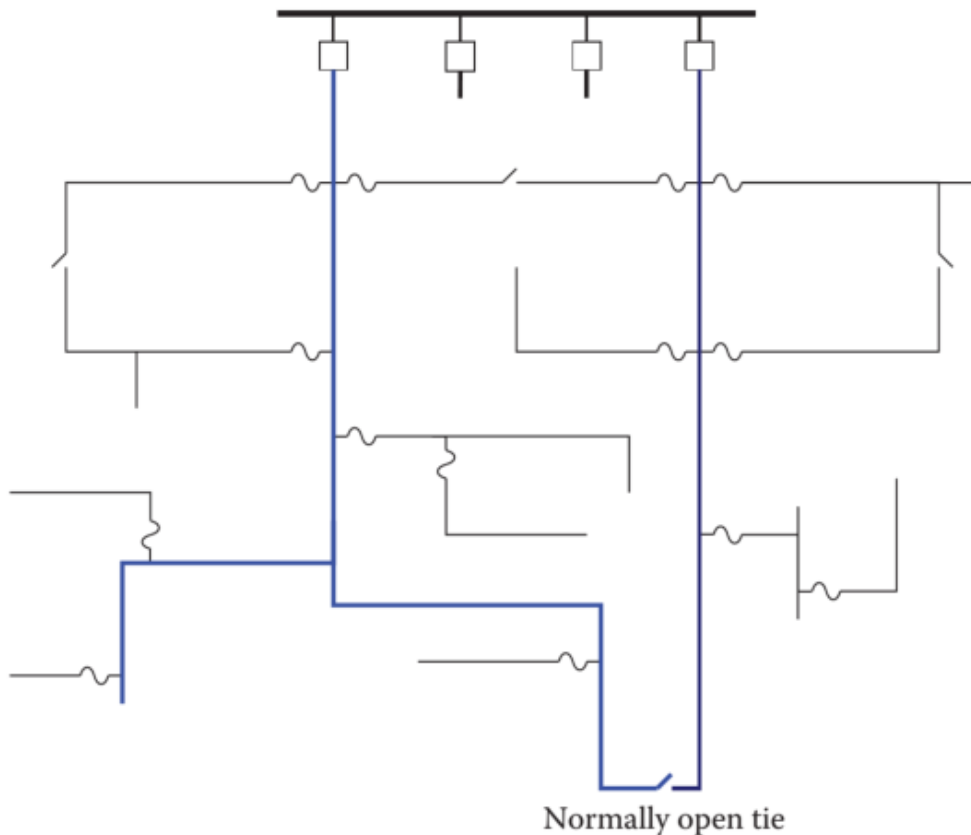


- Two radial circuits with normally open ties to each other.
- For improved reliability, radial circuits are often provided with normally open tie points to other circuits. The circuits are still operated radially, but if a fault occurs on one of the circuits, the tie switches allow some portion of the faulted circuit to be restored quickly. Normally, these switches are manually operated, but some utilities use automated switches or reclosers to perform these operations automatically.

Primary distribution configurations

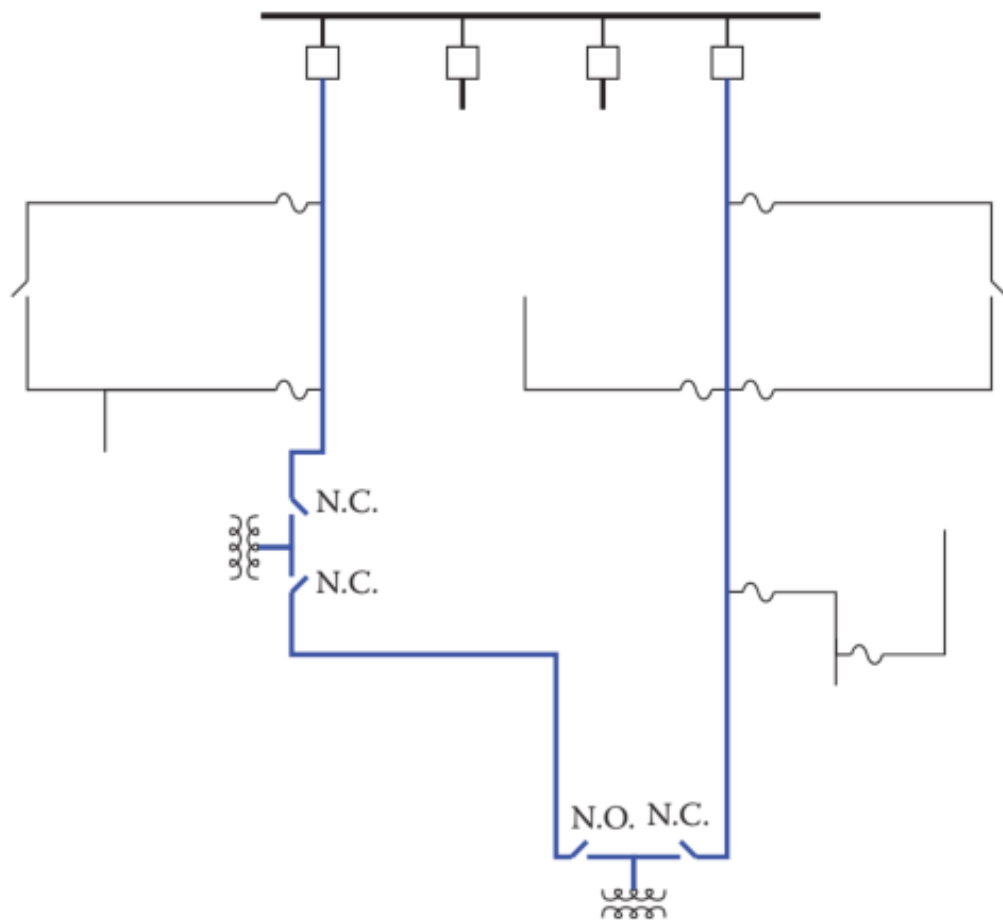

- Primary-loop distribution arrangement.
- A primary-loop scheme is an even more reliable service that is sometimes offered for critical loads such as hospitals.

Primary distribution configurations

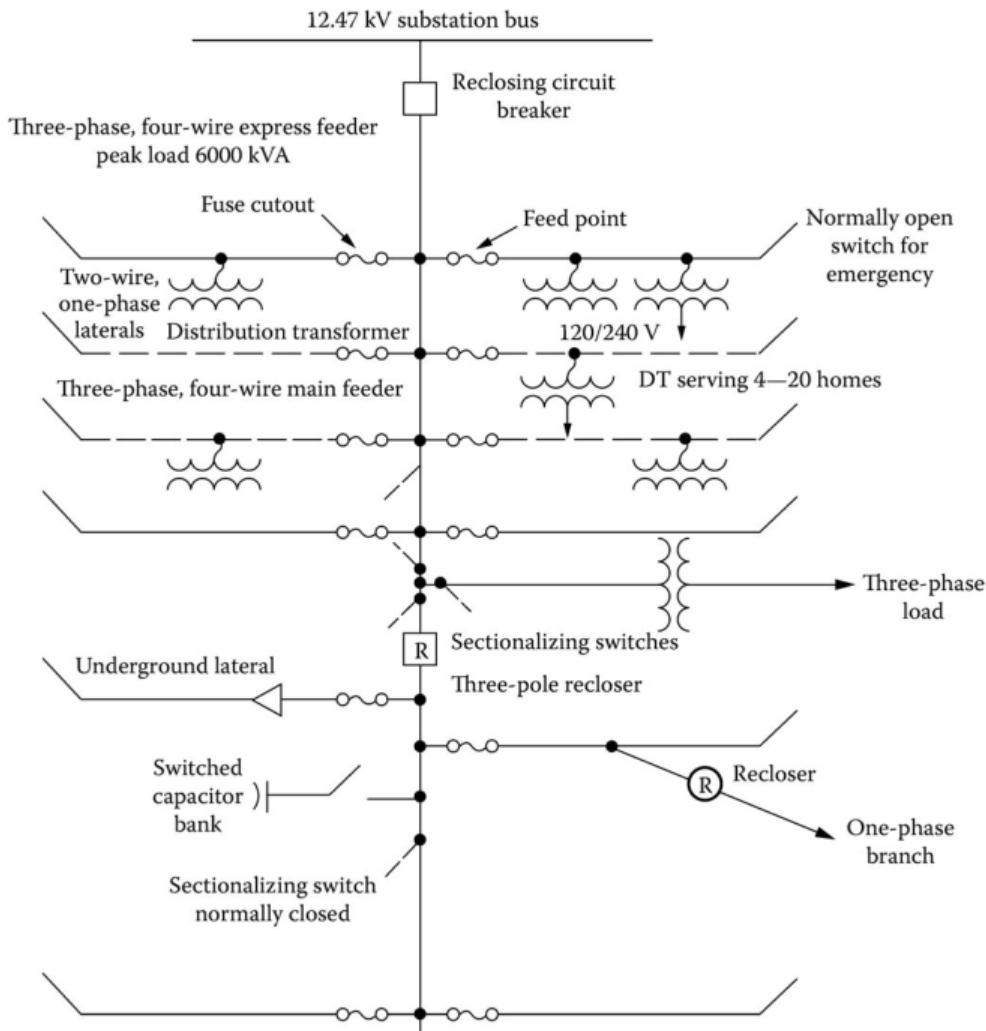

- One-line diagram of typical primary distribution feeders
- Residential area: Approximately 1000 homes per square mile
- Feeder area: 1-4 square miles depending on load density
- 15-30 single-phase laterals per feeder
- 150-500 MVA short-circuit available at substation bus

Primary voltage levels


- Most primary distribution voltages are between 4 and 35 kV. In this class, unless otherwise specified, voltages are given as line-to-line voltages; this follows the normal industry practice.
- The four major voltage classes are 5, 15, 25, and 35 kV. A voltage class is a term applied to a set of distribution voltages and the equipment common to them; it is not the actual system voltage. For example, a 15-kV insulator is suitable for application on any 15-kV class voltage, including 12.47, 13.2, and 13.8 kV.
- Utilities most widely use the 15-kV voltages. The most common 15-kV voltage is 12.47 kV, which has a line-to-ground voltage of 7.2 kV.
- The dividing line between distribution and sub-transmission is often gray. Some lines act as both sub-transmission and distribution circuits. A 34.5-kV circuit may feed a few 12.5-kV distribution substations, but it may also serve some load directly. Some utilities would refer to this as sub-transmission; others would refer to this as distribution.
- We saw a move to higher-voltage primary distribution systems. Higher-voltage distribution systems have advantages and disadvantage.

Primary voltage levels

Class, kV	3 ϕ Voltage	
2.5	2,300	3W- Δ
	2,400 ^a	3W- Δ
5.0	4,000	3W- Δ or 3W-Y
	4,160 ^a	4W-Y
	4,330	3W- Δ
	4,400	3W- Δ
	4,600	3W- Δ
	4,800	3W- Δ
8.66	6,600	3W- Δ
	6,900	3W- Δ or 4W-Y
	7,200 ^a	3W- Δ or 4W-Y
	7,500	4W-Y
	8,320	4W-Y
	15	11,000
11,500		3W- Δ
12,000		3W- Δ or 4W-Y
12,470 ^a		4W-Y
13,200 ^a		3W- Δ or 4W-Y
13,800 ^a		3W- Δ
25	14,400	3W- Δ
	22,900 ^a	4W-Y
34.5	24,940 ^a	4W-Y
	34,500 ^a	4W-Y

^a Most common voltage in the individual classes.

- The 15 kV-class primary voltage levels are most commonly used. The most common primary distribution voltage in use throughout North America is 12.47 kV. However, the current trend is toward higher voltages, for example, the 34.5 kV class is gaining rapid acceptance. The 5 kV class continues to decline in usage. Some distribution systems use more than one primary voltage, for example, 12.47 and 34.5 kV.
- We saw a move to higher-voltage primary distribution systems. Higher-voltage distribution systems have advantages and disadvantage.

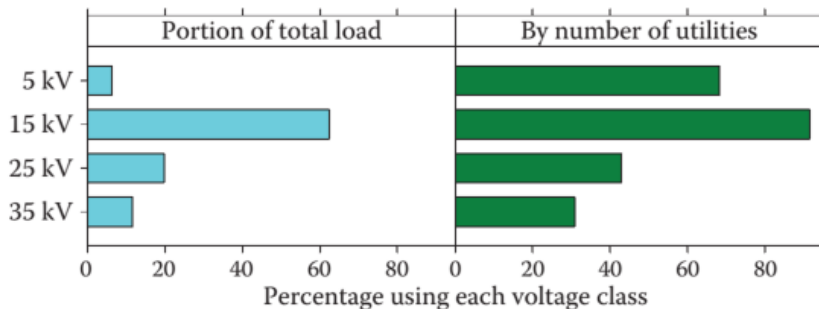

Primary voltage levels


Advantages	Disadvantages
<i>Voltage drop</i> —A higher-voltage circuit has less voltage drop for a given power flow.	<i>Reliability</i> —An important disadvantage of higher voltages: longer circuits mean more customer interruptions.
<i>Capacity</i> —A higher-voltage system can carry more power for a given ampacity.	<i>Crew safety and acceptance</i> —Crews do not like working on higher-voltage distribution systems.
<i>Losses</i> —For a given level of power flow, a higher-voltage system has fewer line losses.	<i>Equipment cost</i> —From transformers to cable to insulators, higher-voltage equipment costs more.
<i>Reach</i> —With less voltage drop and more capacity, higher-voltage circuits can cover a much wider area.	
<i>Fewer substations</i> —Because of longer reach, higher-voltage distribution systems need fewer substations.	

- A 34.5 kV mainline is typically 30-mile long.
- A 12.5 kV mainline is typically 8-mile long.
- Overall, the 15-kV class voltages provide a good balance between cost, reliability, safety, and reach. Although a 15-kV circuit does not naturally provide long reach, with voltage regulators and feeder capacitors, it can be stretched to reach 20 mi or more. That said, higher voltages have advantages, especially for rural lines and for high-load areas, particularly where substation space is expensive.

Secondary distribution configurations

- The standard voltage level for single-phase residential loads is 120/240 V. It is supplied through three-wire single-phase services, from which both 120 V lighting and 240 V single-phase power connections are made to large household appliances such as ranges, clothes dryers, and water heaters.
- Generally, the secondary distribution systems are designed in single phase for areas of residential customers and in three phase for areas of industrial or commercial customers with high-load densities. The types of the secondary distribution systems include the following:
 - The separate-service system for each consumer with separate distribution transformer and secondary connection
 - The radial system with a common secondary main, which is supplied by one distribution transformer and feeding a group of consumers
 - The secondary-bank system with a common secondary main that is supplied by several distribution transformers, which are all fed by the same primary feeder
 - The secondary-network system with a common grid-type main that is supplied by a large number of the distribution transformers, which may be connected to various feeders for their supplies
- The separate-service system is seldom used and serves the industrial- or rural-type service areas.
- Generally speaking, most of the secondary systems for serving residential, rural, and light commercial areas are radial designed.


Secondary distribution configurations

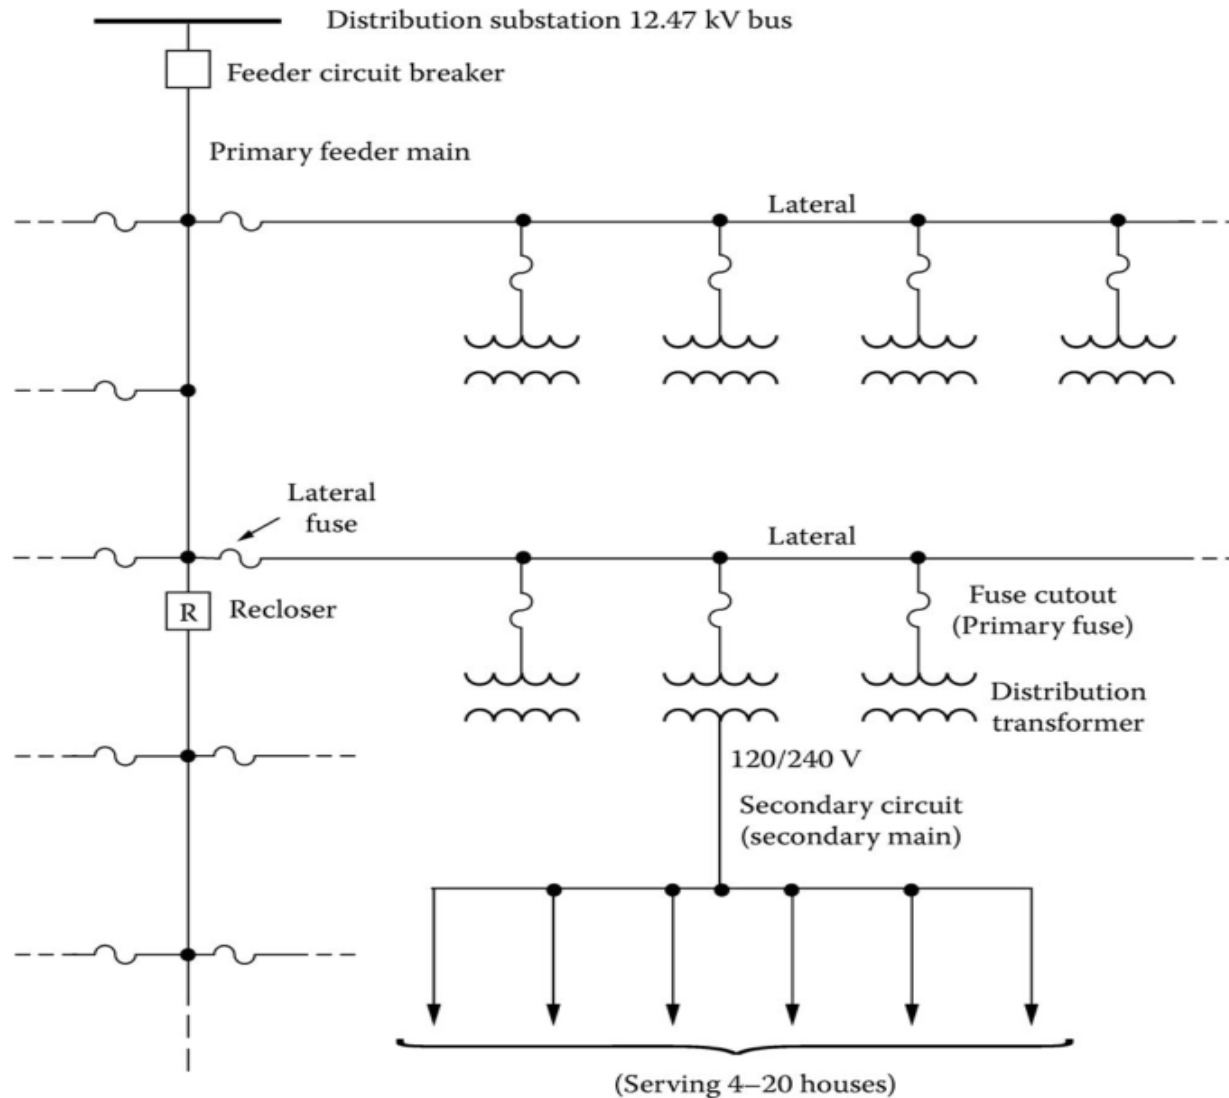

- One-line diagram of a simple radial secondary system

Secondary distribution configurations


- Secondary banking
- The “banking” of the distribution transformers, that is, parallel connection, or, in other words, interconnection, of the secondary sides of two or more distribution transformers, which are supplied from the same primary feeder, is sometimes practiced in residential and light-commercial areas where the services are relatively close to each other, and therefore, the required spacing between transformers is little.

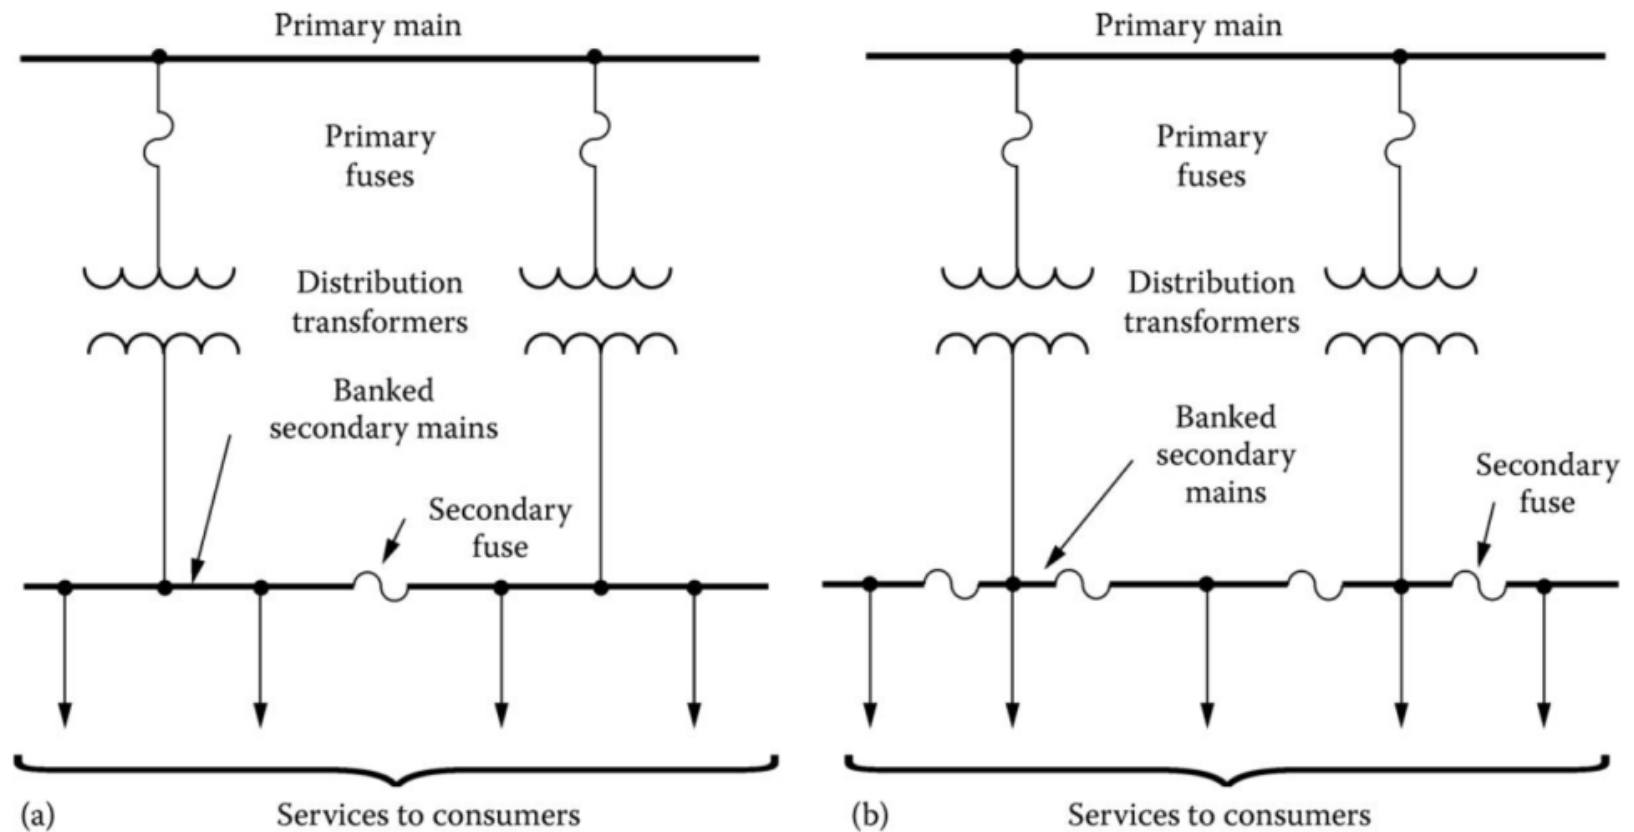


Type 1 secondary banking

Type 2 secondary banking

Secondary distribution configurations

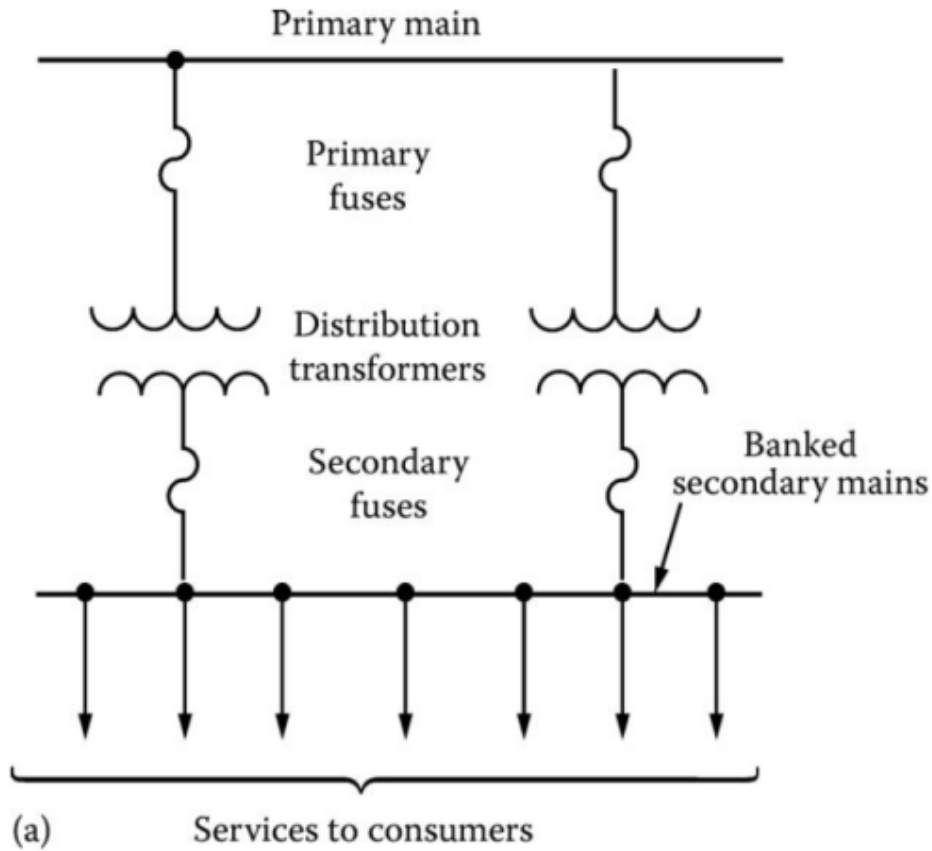


Type 3 secondary banking

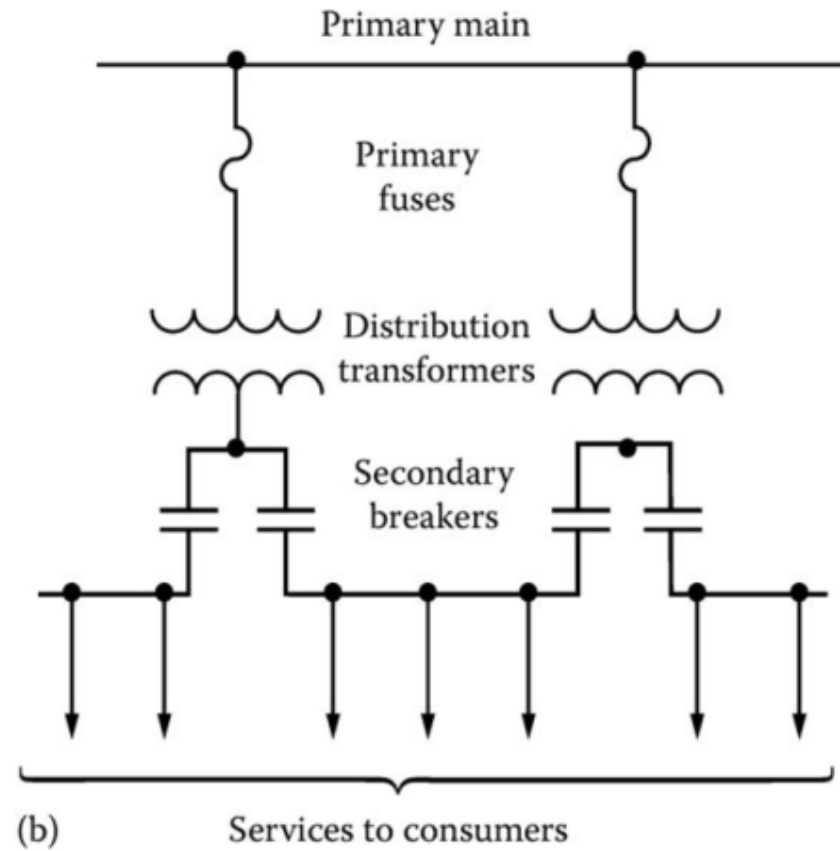

Type 4 secondary banking

Secondary distribution configurations

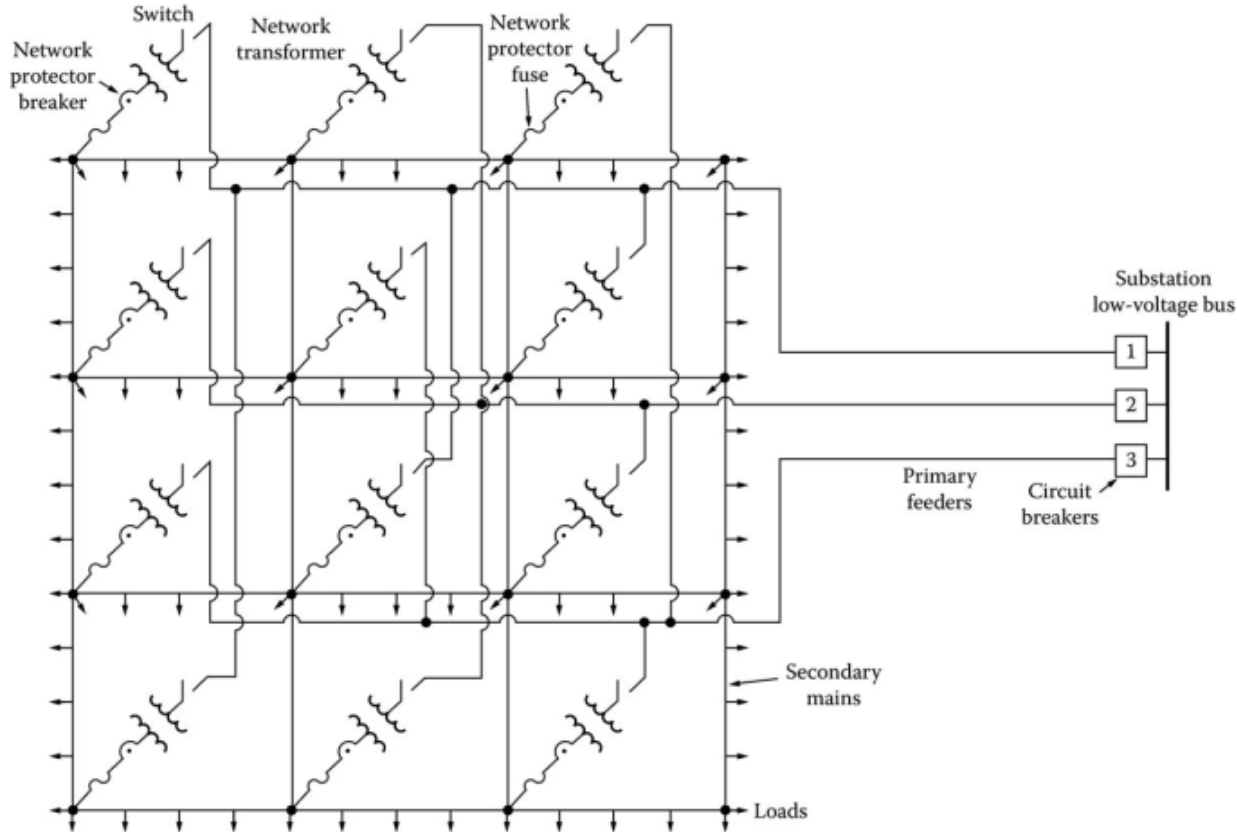

- Generally speaking, most of the secondary systems are radial designed except for some specific service areas (e.g., downtown areas or business districts, some military installations, hospitals) where the reliability and service-continuity considerations are far more important than the cost and economic considerations. Therefore the secondary systems may be designed in grid- or mesh-type network configurations in those areas.
- One-line diagram of the small segment of a secondary-network system.

Typical distribution circuit parameters


	Most Common Value	Other Common Values
Substation Characteristics		
Voltage	12.47 kV	4.16, 4.8, 13.2, 13.8, 24.94, and 34.5 kV
Number of station transformers	2	1 to 6
Substation transformer size	21 MVA	5 to 60 MVA
Number of feeders per bus	4	1 to 8
Feeder Characteristics		
Peak current	400 A	100 to 600 A
Peak load	7 MVA	1 to 15 MVA
Power factor	0.98 lagging	0.8 lagging to 0.95 leading
Number of customers	400	50 to 5000
Length of feeder mains	4 mi	2 to 15 mi
Length including laterals	8 mi	4 to 25 mi
Area covered	25 mi ²	0.5 to 500 mi ²
Mains wire size	500 kcmil	4/0 to 795 kcmil
Lateral tap wire size	1/0	#4 to 2/0
Lateral tap peak current	25 A	5 to 50 A
Lateral tap length	0.5 mi	0.2 to 5 mi
Distribution transformer size (1 ph)	25 kVA	10 to 150 kVA

Radial Feeders


Components of the feeder may consist of the following:

1. Three-phase primary “main” feeder
 2. Three-phase, two-phase (“V” phase), and single-phase laterals
 3. Step-type voltage regulators
 4. In-line transformers
 5. Shunt capacitor banks
 6. Distribution transformers
 7. Secondaries
 8. Three-phase, two-phase, and single-phase loads
- The loading of a distribution feeder is inherently unbalanced because of the large number of unequal single-phase loads that must be served.
 - An additional unbalance is introduced by the nonequilateral conductor spacings of the three-phase overhead and underground line segments.
 - Conventional power-flow and short-circuit programs used for transmission system studies are not adequate.
 - Three-phase models of the major components must be utilized.

Illustration of load connected to a distribution transformer

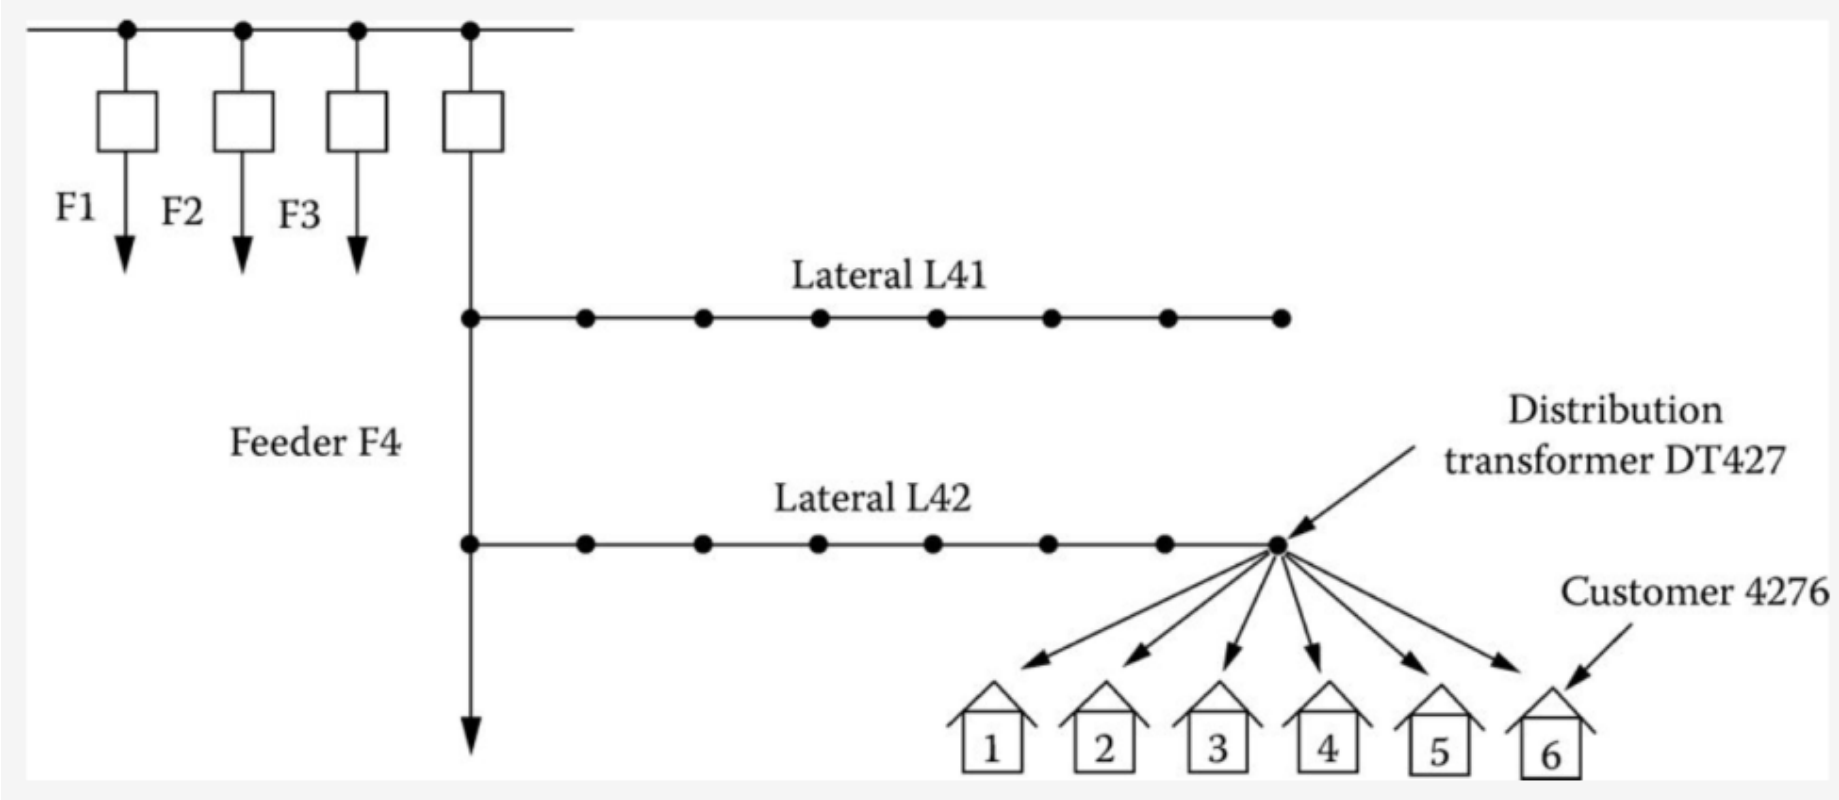


Typical daily load profiles

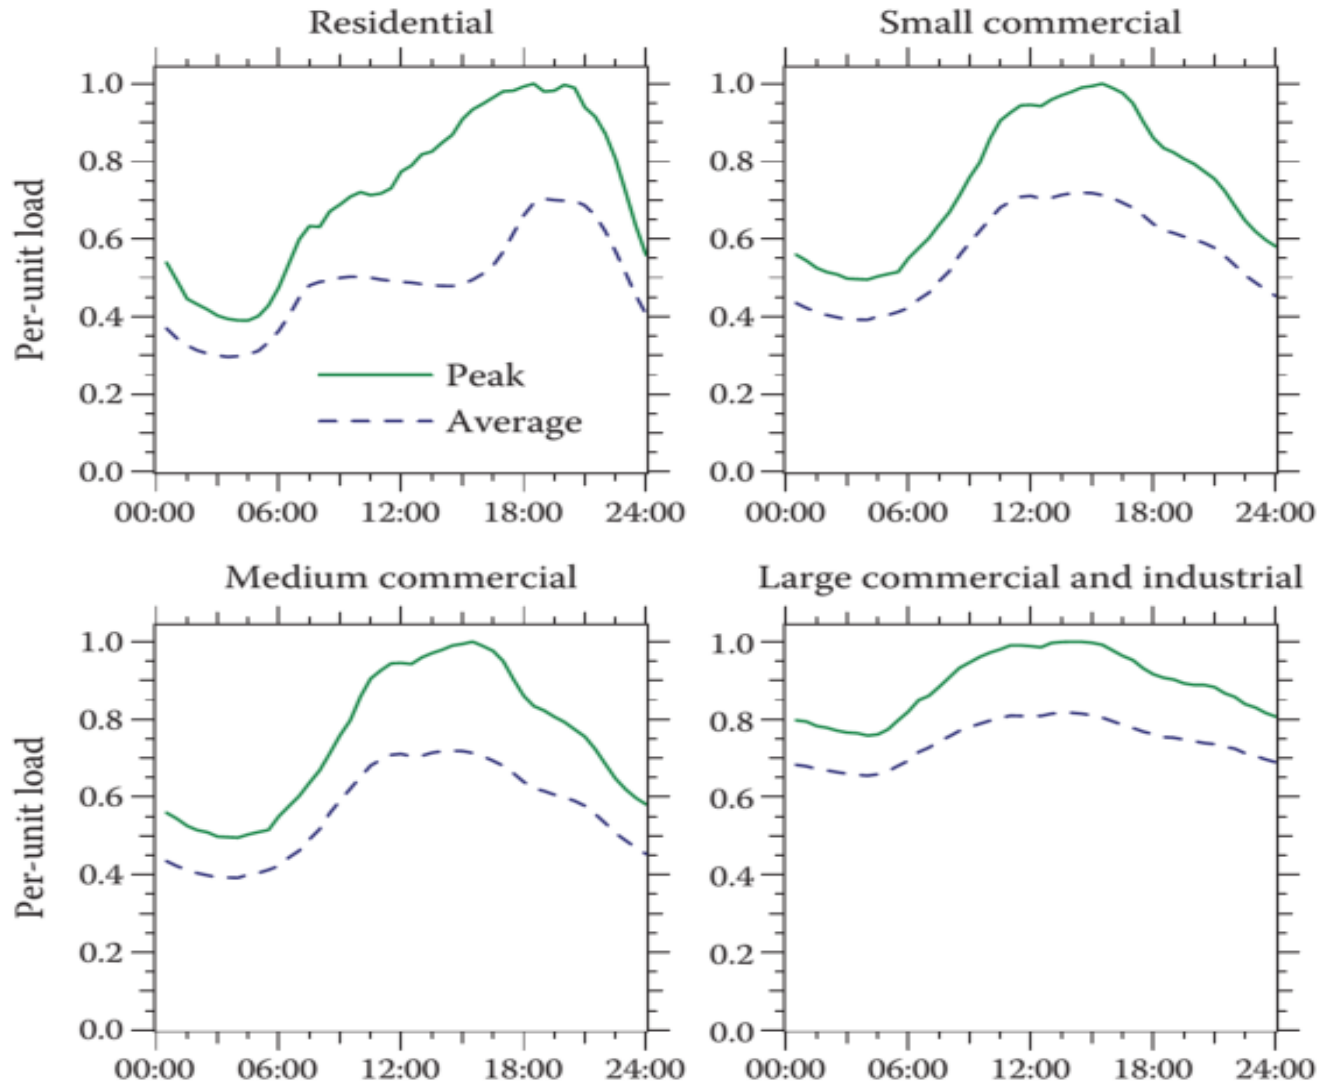



T. A. Short, Electric Power Distribution Handbook, 2nd ed. Boca Raton, FL: CRC, 2014.

Aggregate load curves

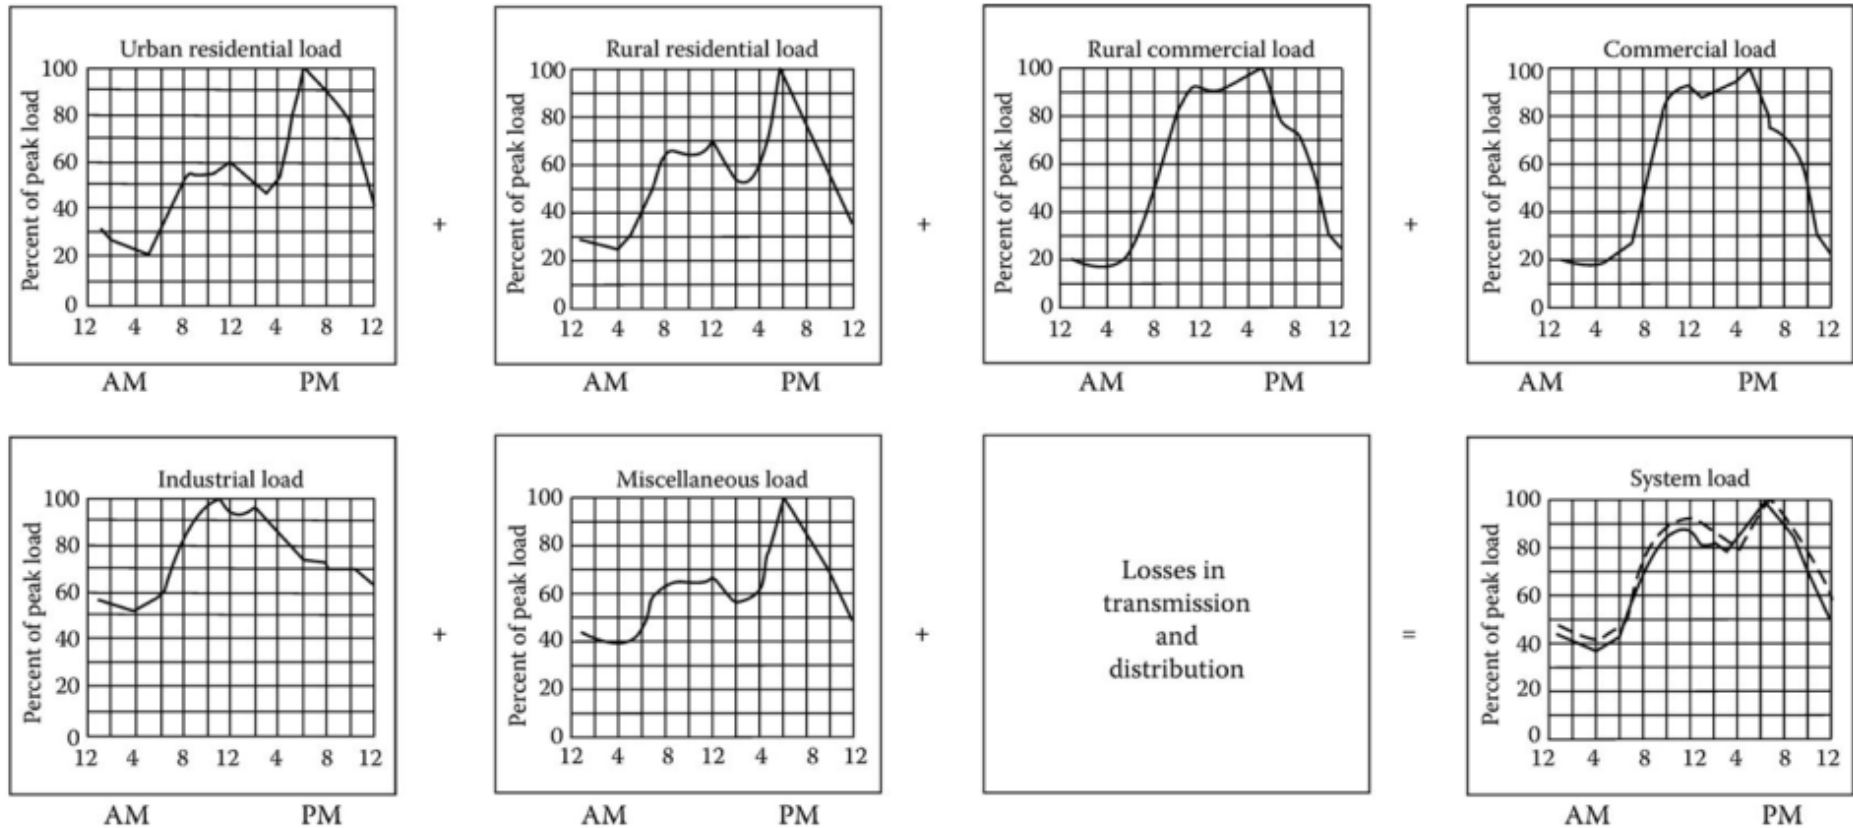

Development of aggregate load curves for winter peak period. Miscellaneous load includes street lighting and sales to other agencies. Dashed curve shown on system load diagram is actual system generation sent out. Solid curve is based on group load study data.

Voltage drop at peak load

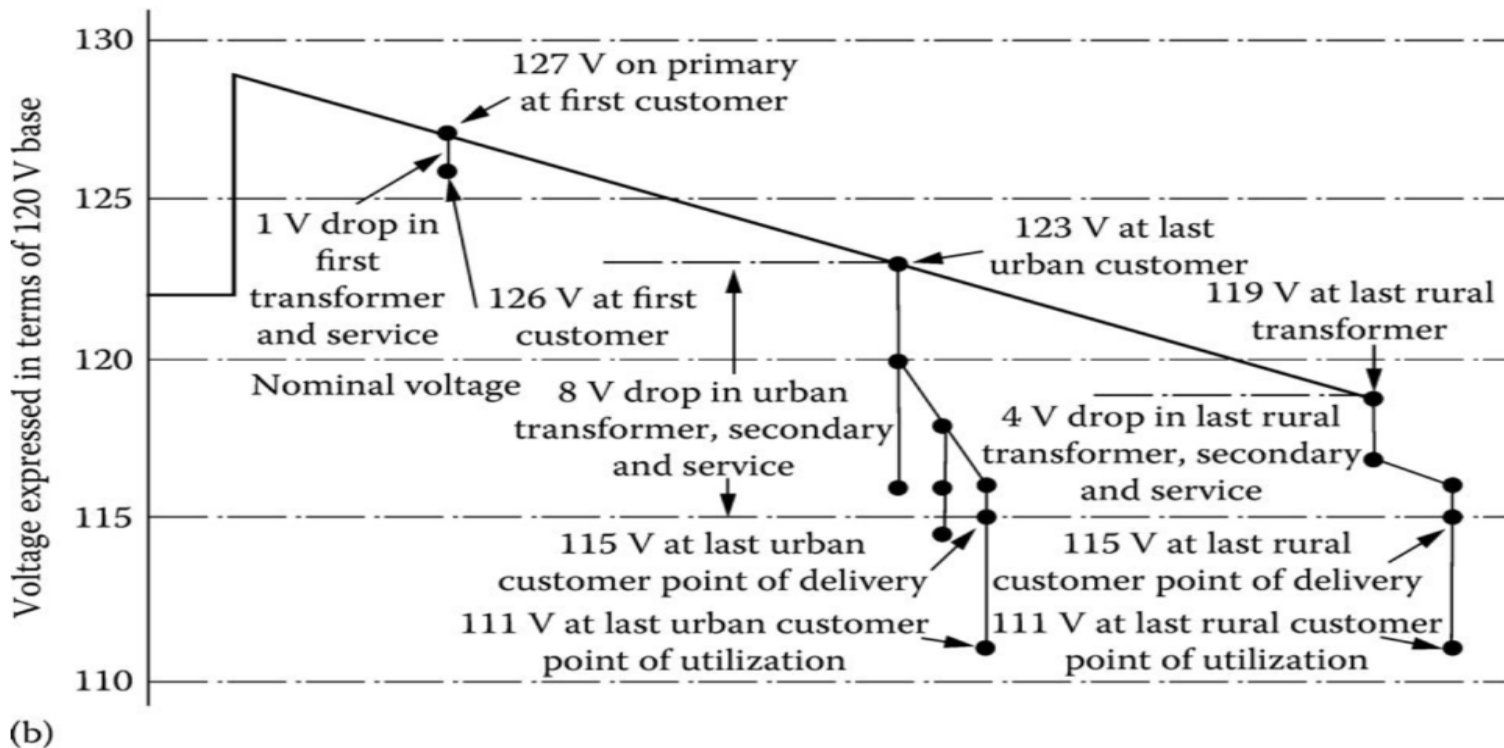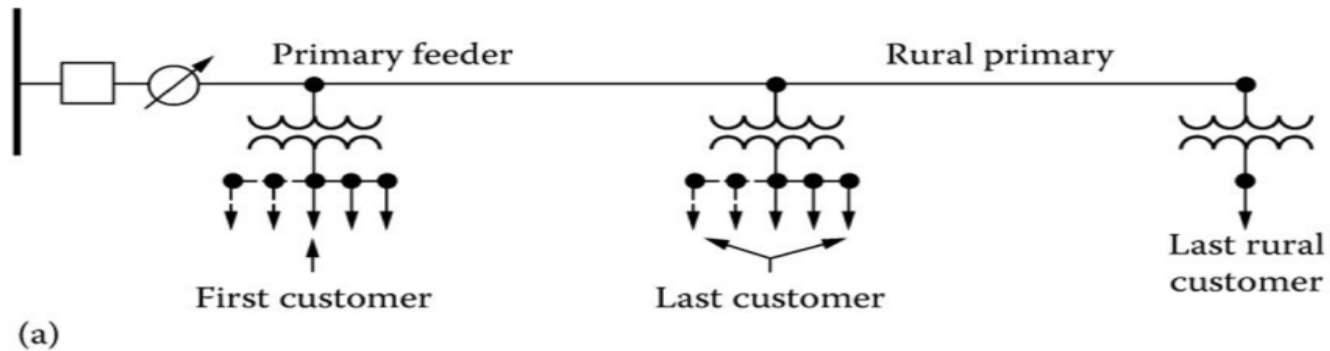

Annual utility distribution budgets

	Average	Range
Per dollar of distribution asset	0.098	0.0916 to 0.15
Per customer	195	147 to 237
Per 1000 kWh	8.9	3.9 to 14.1
Per mile of circuit	9400	4800 to 15,200
Per substation	880,000	620,000 to 1,250,000


- Numbers are in U.S. dollars.
- Distribution systems are capital-intensive business.
- Distribution asset: 49.5% of the total distribution resource; labor: 21.8%; materials: 12.9%.

Distribution circuit loss statistics (Percent)


	Quartiles			
	Average	25%	50%	75%
Primary line losses	1.40	0.61	1.04	1.84
Transformer load losses	0.38	0.24	0.34	0.46
Transformer no-load losses	1.59	1.03	1.49	1.89
Secondary line losses	0.31	0.16	0.27	0.44
Total losses	3.64	2.52	3.09	4.32

North American versus European distribution layouts

North American layout

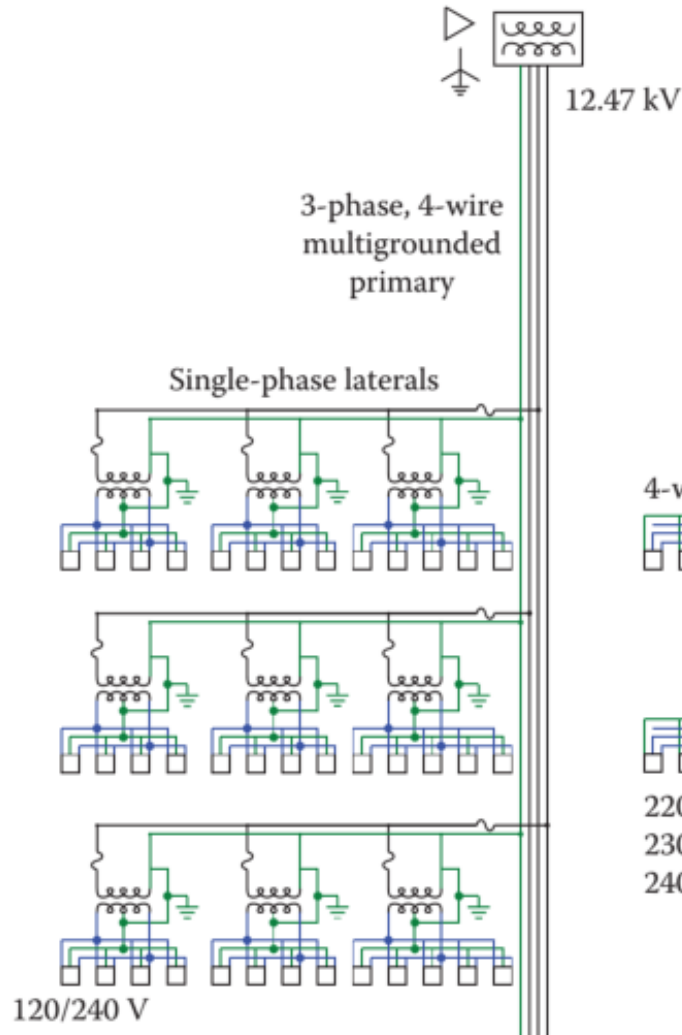


European layout

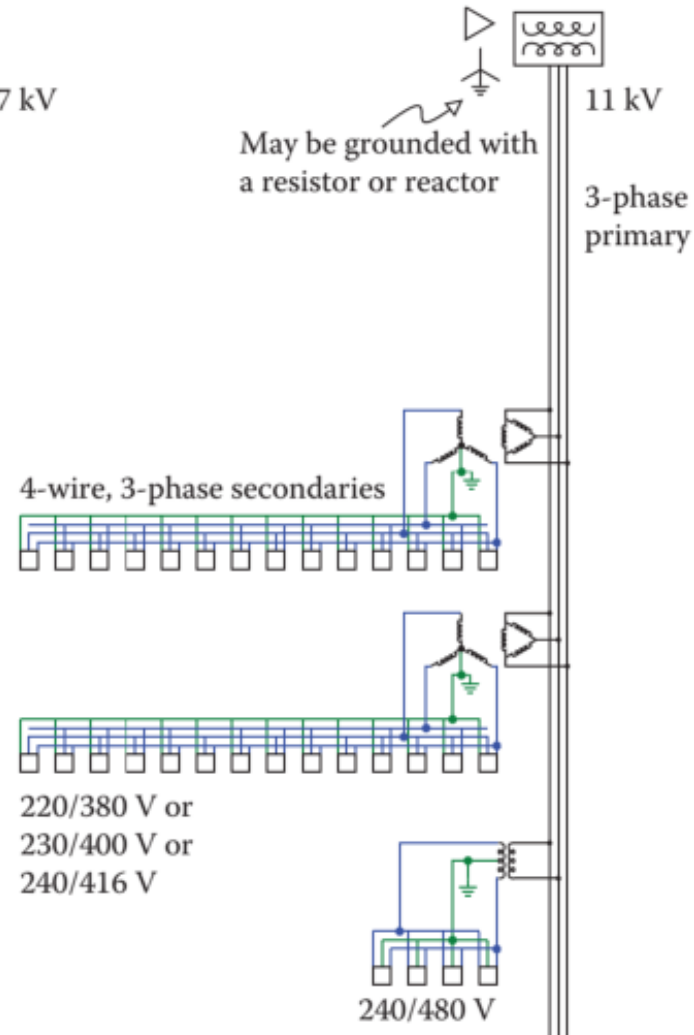

North American versus European distribution layouts

- Distribution systems around the world have evolved into different forms. The two main designs are North American and European.
- For both forms, hardware is much the same: conductors, cables, insulators, arresters, regulators, and transformers are very similar. Both systems are radial, and voltages and power carrying capabilities are similar.
- The main differences are in layouts, configurations, and applications.
- Relative to North American designs, European systems have larger transformers and more customers per transformer. Most European transformers are three phase and on the order of 300 to 1000 kVA, much larger than the typical North American 25- or 50-kVA single-phase units.
- Secondary voltages have motivated many of the differences in distribution systems. North America has standardized on a 120/240-V secondary system; on these, voltage drop constrains how far utilities can run secondaries, typically not more than 250 ft. In European designs, higher secondary voltages allow secondaries to stretch to almost 1 mi. European secondaries are largely three phase and most European countries have a standard secondary voltage of 220, 230, or 240 V, twice the North American standard. With twice the voltage, a circuit feeding the same load can reach 4 times the distance. And, because three-phase secondaries can reach over twice the length of a single-phase secondary, overall, a European secondary can reach 8 times the length of an American secondary for a given load and voltage drop.
- In the European design, secondaries are used much like primary laterals in the North American design. In European designs, the primary is not tapped frequently, and primary-level fuses are not used as much.

Control and communication hierarchy

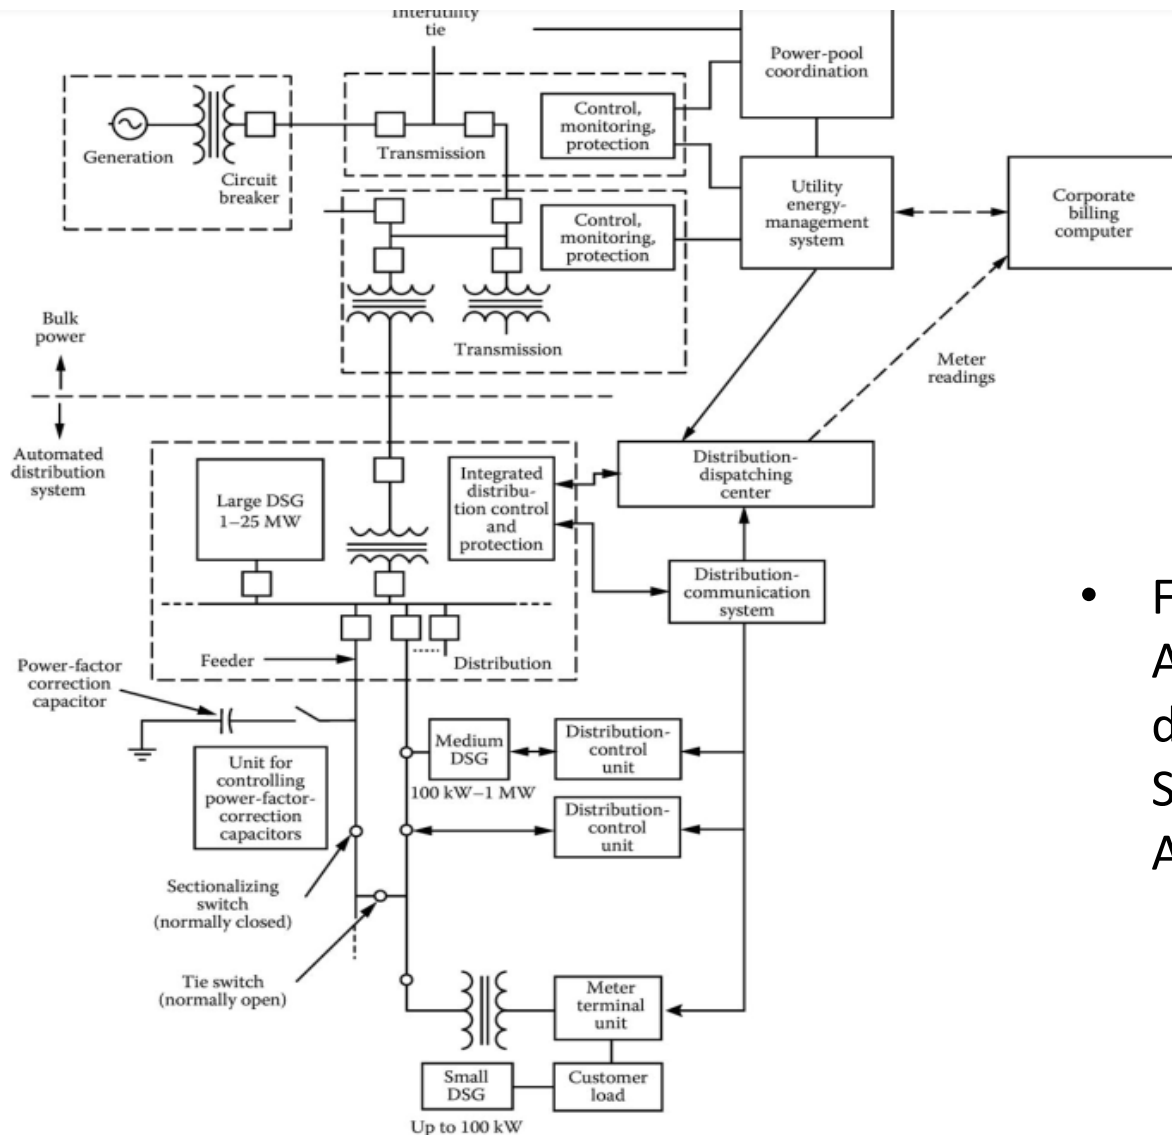

- From Chen, A.C.M., Automated power distribution, IEEE Spectrum, pp. 55-60, April 1982.

Electricity rate structure

- There are several types of rate structures used by the utilities, and some of them are
 - Flat demand rate structure
 - Straight-line meter rate structure
 - Block meter rate structure
 - Demand rate structure
 - Season rate structure
 - Time-of-day (or peak-load pricing) structure

Electricity rate structure

- The flat rate structure provides a constant price per kilowatthour, which does not change with the time of use, season, or volume.
- The straight-line meter rate structure is similar to the flat structure. It provides a single price per kilowatthour without considering customer demand costs.
- The block meter rate structure provides lower prices for greater usage, that is, it gives certain prices per kilowatthour for various kilowatthour blocks where the price per kilowatthour decreases for succeeding blocks. Theoretically, it does not encourage energy conservation and off-peak usage. Therefore, it causes a greater than necessary peak and, consequently, excess idle generation capacity during most of the time, resulting in higher rates to compensate the cost of a greater peak-load capacity.
- The demand rate structure recognizes load factor and consequently provides separate charges for demand and energy. It gives either a constant price per kilowatthour consumed or a decreasing price per kilowatthour for succeeding blocks of energy used.
- The seasonal rate structure specifies higher prices per kilowatthour used during the season of the year in which the system peak occurs (on-peak season) and lower prices during the season of the year in which the usage is the lowest (off-peak season).
- The time-of-day rate structure (or peak-load pricing) is similar to the seasonal load rate structure. It specifies higher prices per kilowatthour used during the peak period of the day and lower prices during the off-peak period of the day.
- The seasonal rate structure and the time-of-day rate structure are both designed to reduce the system's peak load and therefore reduce the system's idle standby capacity.

Electricity rate structure

Minimum Charge (Including First 20 kWh or Fraction Thereof)	\$2.25/Month
Next 80 kWh	\$0.0355/kWh
Next 100 kWh	\$0.0321/kWh
Next 200 kWh	\$0.0296/kWh
Next 400 kWh	\$0.0265/kWh
Consumption in excess of 800 kWh	\$0.0220/kWh

- For example, if the consumption is 2200 kWh

First 20 kWh @ \$2.25 (flat rate)	= \$2.25
Next 80 kWh × 0.0355	= \$2.84
Next 100 kWh × 0.0321	= \$3.21
Next 200 kWh × 0.096	= \$5.92
Next 400 kWh × 0.0265	= \$10.60
Additional 1400 kWh × 0.0220	= \$30.80
2200 kWh	= \$55.62
Environmental surcharge	= \$0.25
County energy tax	= \$1.95
Fuel cost adjustment	= \$24.33
State sales tax	= \$3.28
Total amount	= \$85.43

Electricity rate structure

On-peak season (June 1–October 31)

First 50 kWh or less/month for	\$4.09		
Next 50 kWh/month	@5.5090/kWh	Next 3000 kWh/month	@2.7830/kWh
Next 500 kWh/month	@4.8430/kWh	All additional kWh/month	@2.6490/kWh
Next 1400 kWh/month	@4.0490/kWh		
Next 3000 kWh/month	@3.8780/kWh		
All additional kWh/month	@3.3390/kWh		

- Typical energy rate schedule for commercial users

Off-peak season (November 1–May 31)


First 50 kWh or less/month for	4.09
Next 50 kWh/month	@5.5090/kWh
Next 500 kWh/month	@4.2440/kWh
Next 1400 kWh/month	@3.1220/kWh

Electric meters




- Single-phase electromechanical watthour meter

https://www.ebay.com/i/200773074645?chn=ps&norover=1&mkevt=1&mkrid=711-117182-37290-0&mkcid=2&itemid=200773074645&targetid=474380971144&device=c&mktype=pla&googleloc=9017773&poi=&campaignid=6469750774&mkgroupid=85991902548&rlsataarget=pla-474380971144&abclid=1141186&merchantid=114830794&gelid=CjwKCAjwibzBRAMEiwA1pHZruGBHN6RBu1Ya4PKrWV-qWmlQMukH8crL8GfHgS_jvnHejll9n4HahoCZ4UQAvd_BwE

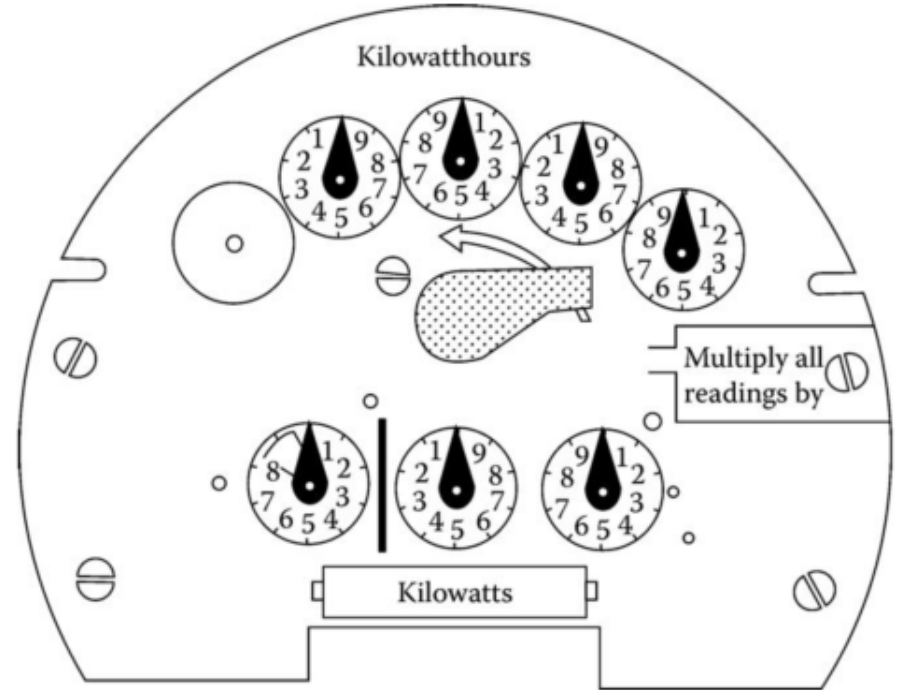

- An electromechanical demand meter for large customers
- A demand meter is basically a watthour meter with a timing element added. The meter functions as an integrator and adds up the kilowatthours of energy used in a certain time interval, for example, 15, 30, or 60 min. Therefore, the demand meter indicates energy per time interval, or average power, which is expressed in kilowatts.

Smart distribution grids

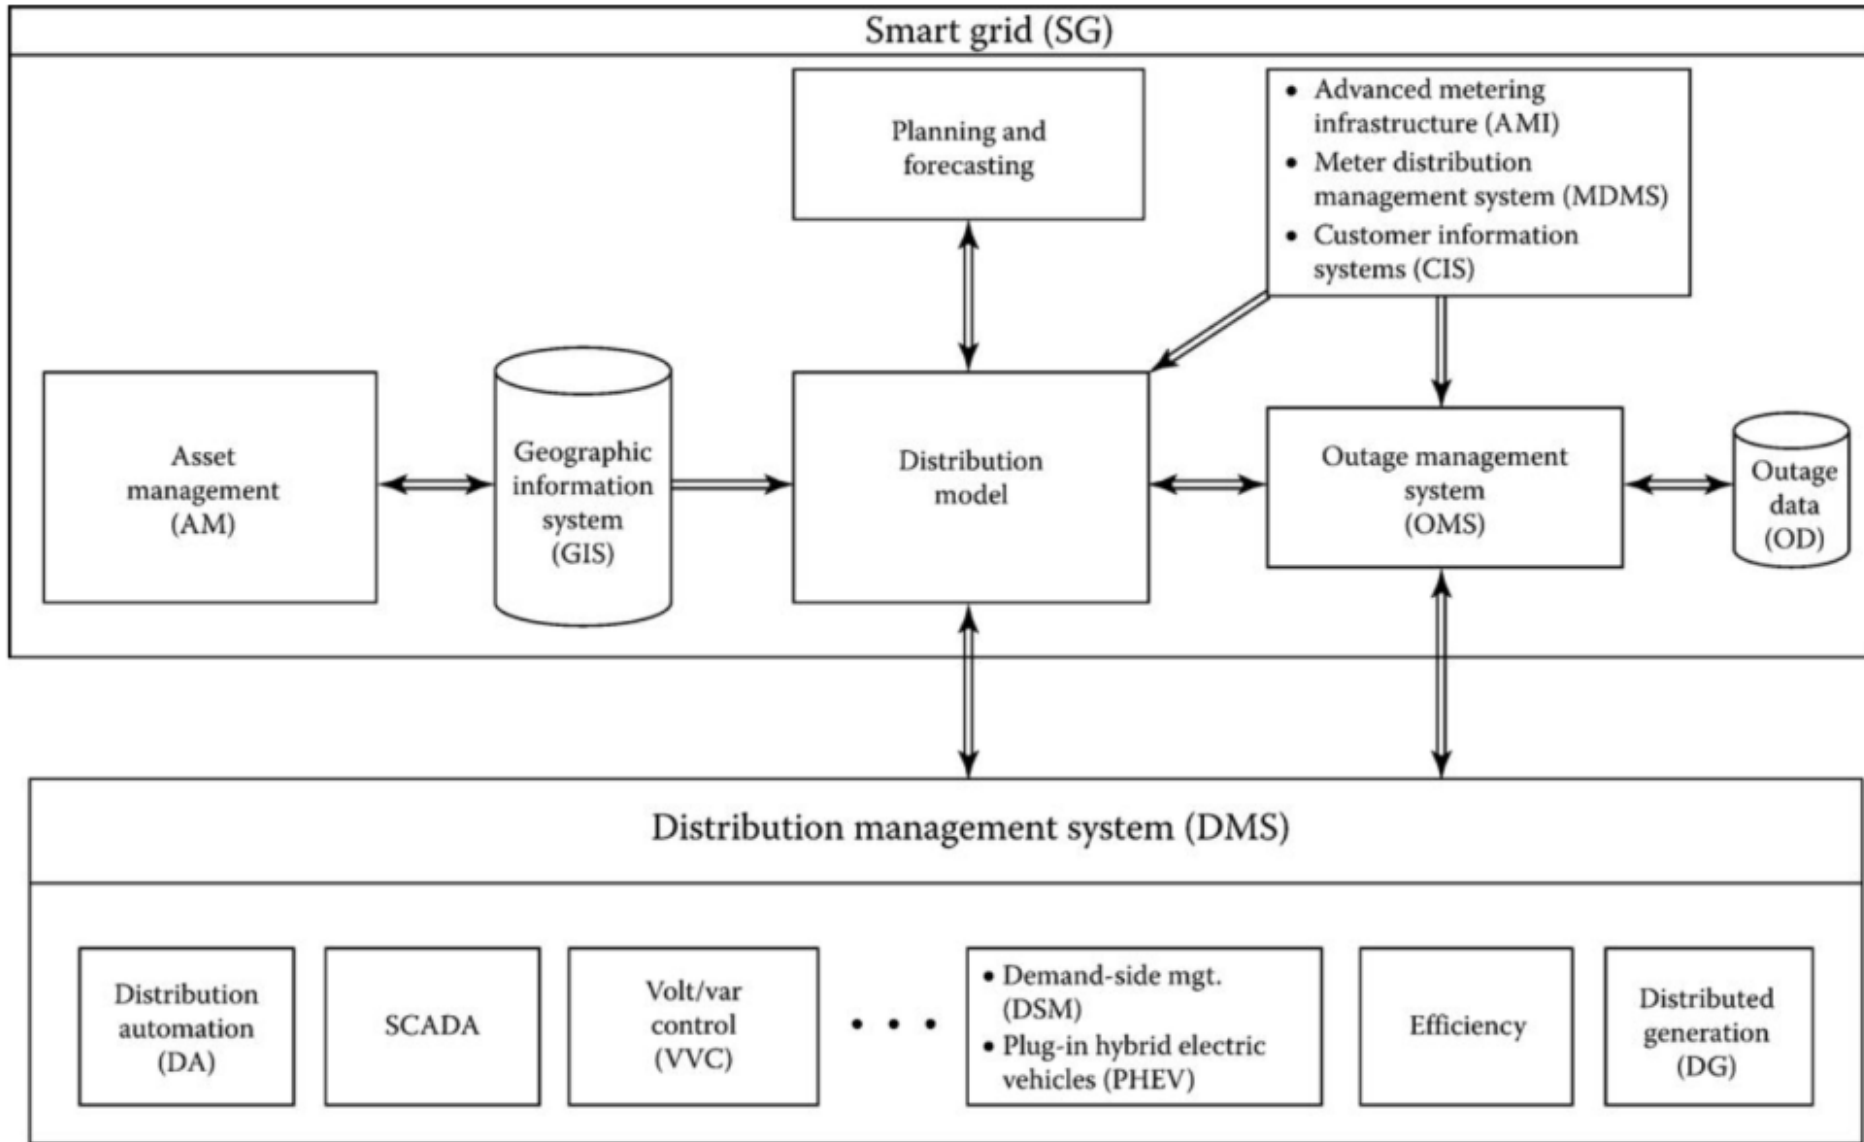

Smart distribution grids

- Discretionary load switching
- Peak load pricing
- Load shedding
- Cold load pickup
- Load reconfiguration
- Voltage regulation
- Transformer load management (TLM)
- Feeder load management (FLM)
- Capacitor control
- Dispersed storage and generation
- Fault detection, control, and isolation
- Load studies
- Condition and state monitoring
- Automatic customer meter reading
- Remote service connection or disconnection
- Switching operations

Thank you!